
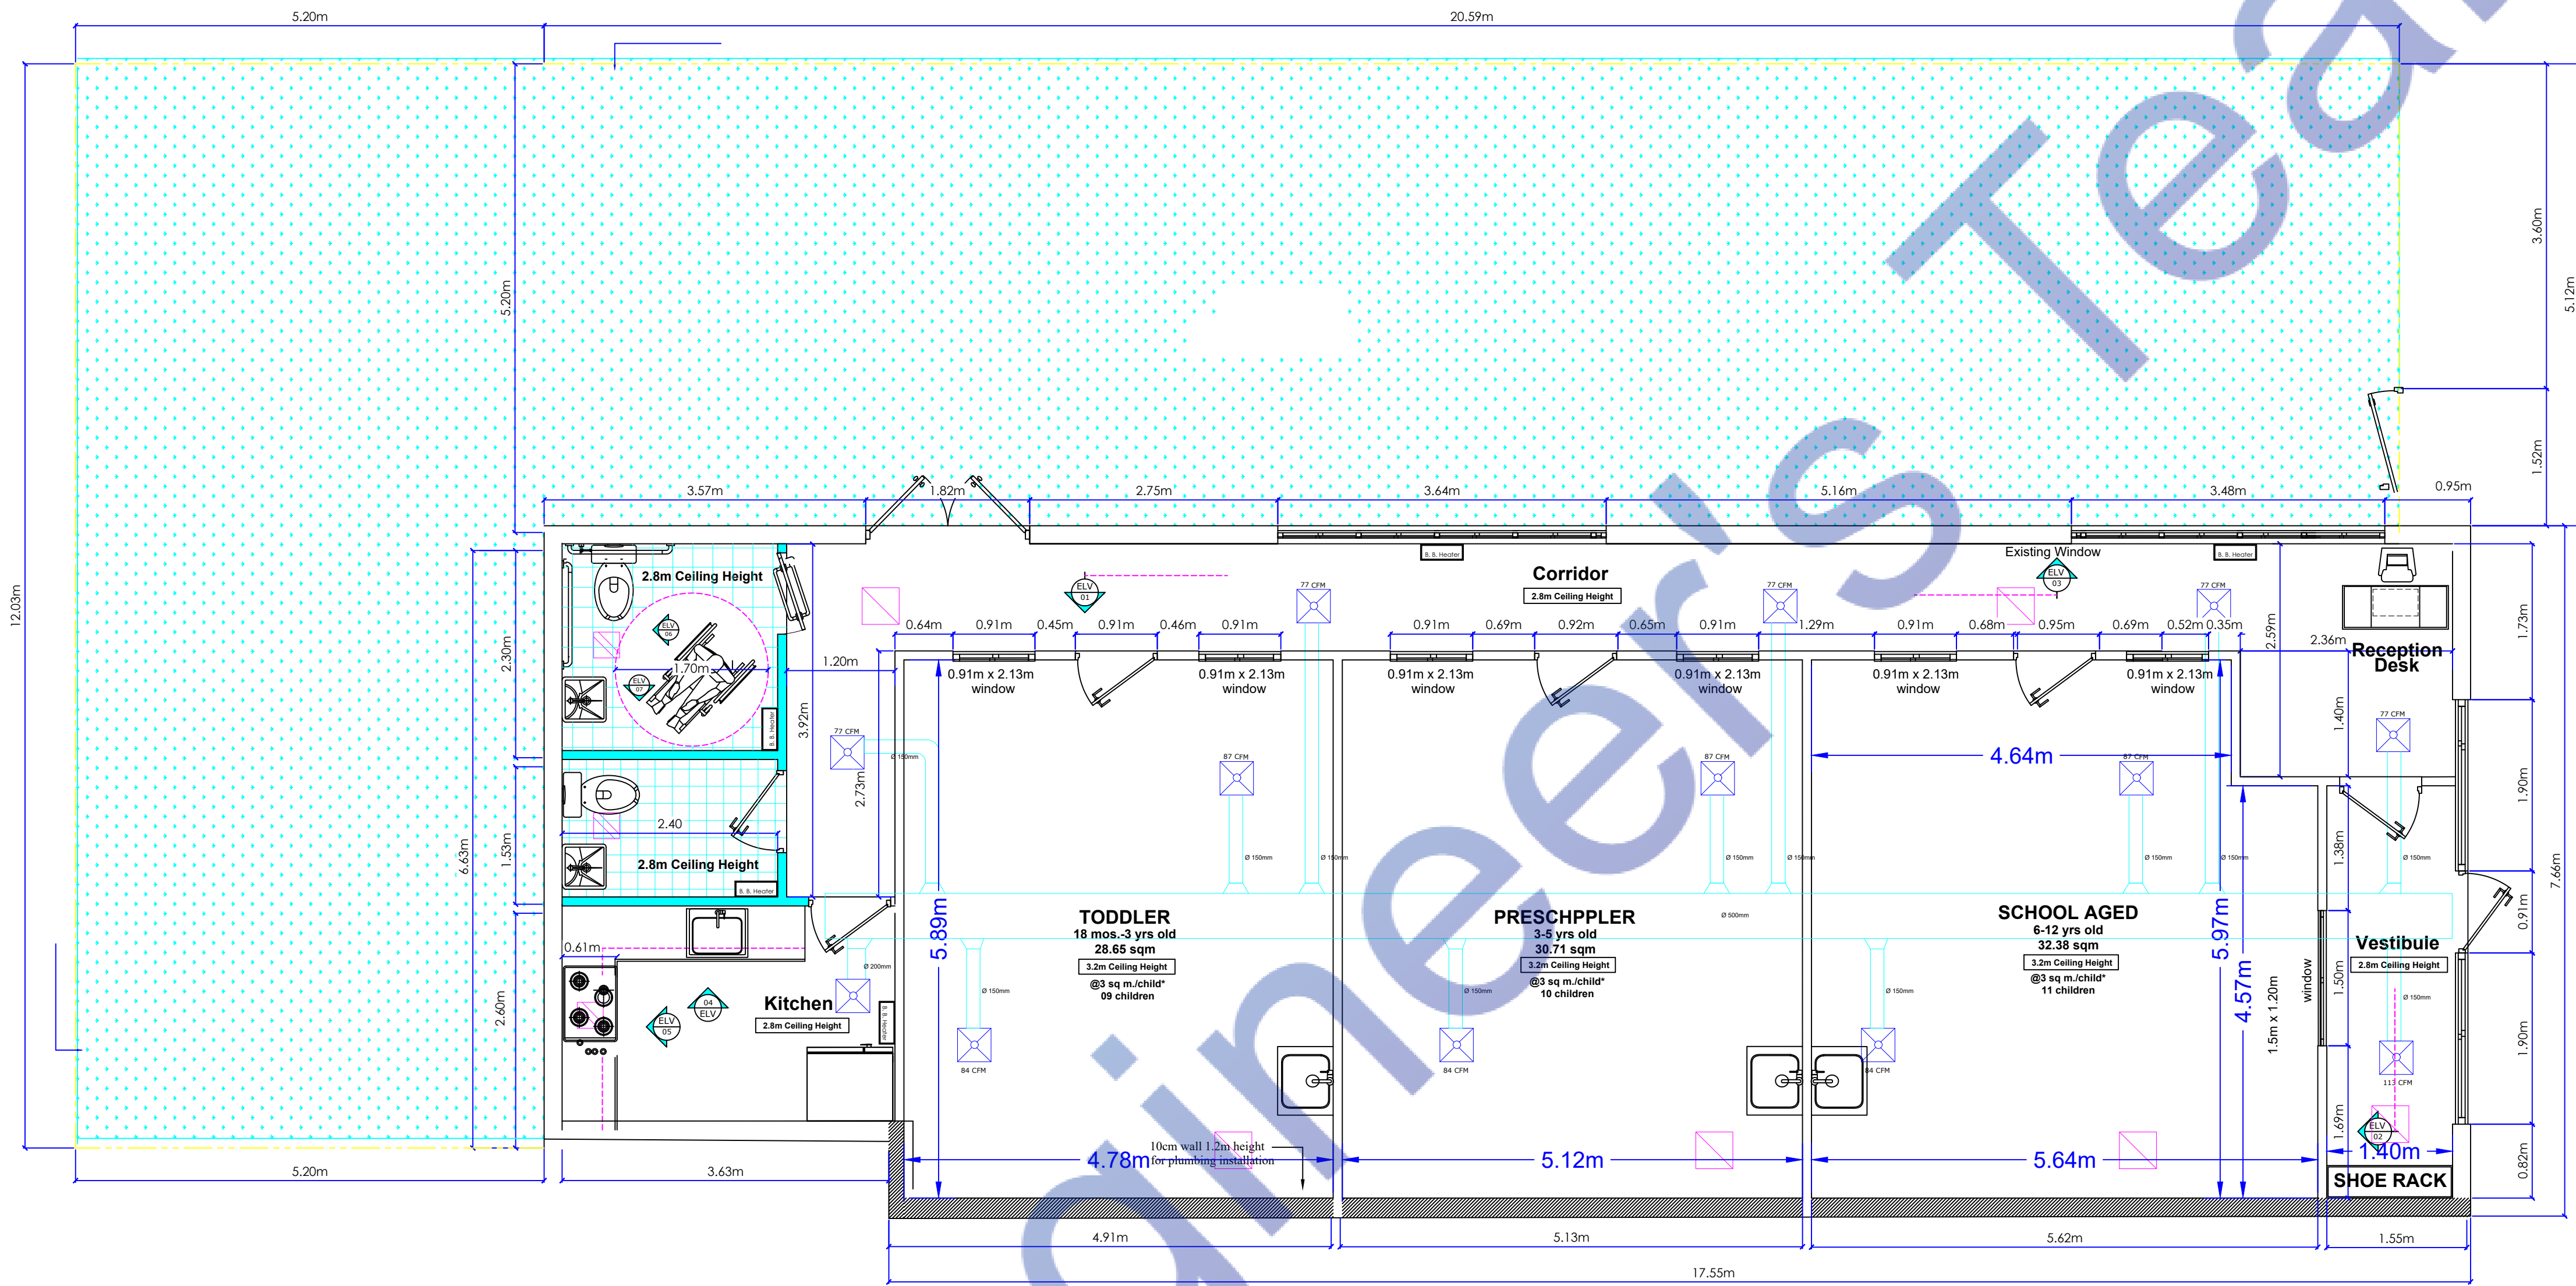


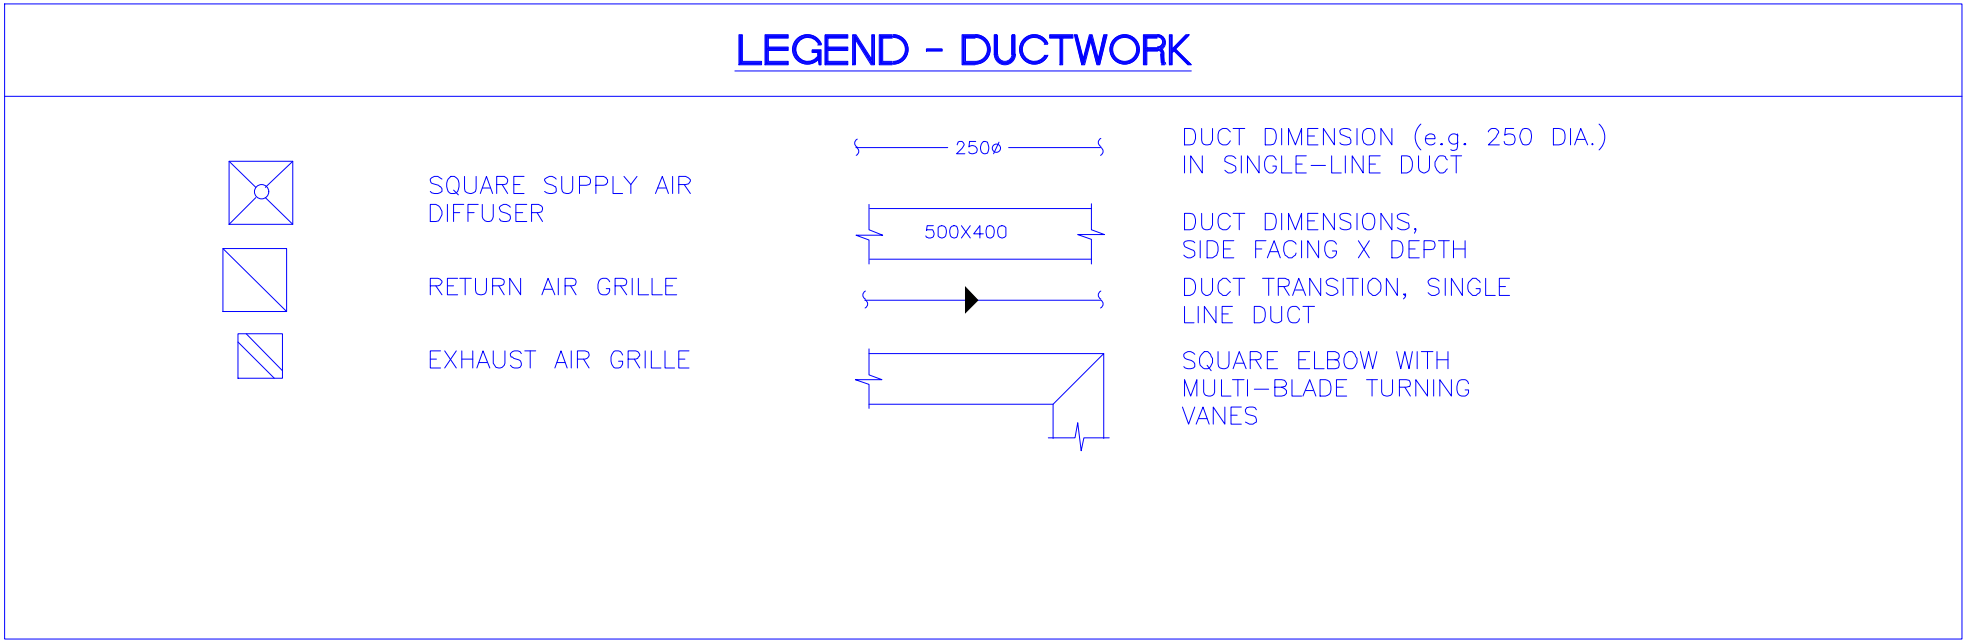

Notes:

1. Mechanical drawings shall be read in conjunction with architectural drawings and detailed elevations.
2. Dedicated MUA already installed for unit 14
3. Contractor to extend ducting as shown on HVAC plan
4. All fresh air requirements and exhaust rates as per ASHRAE 62.1

NOTES:


CONSULTANT:

Zmax Engineering & Consulting Ltd.
360 TaigaNova Crescent
Fort McMurray, AB T9K 0T4
admin@zmaxengineering.com
<http://zmaxengineering.com>


Phone:780-804-5959\780-880-7756

CONTACT:

Mohammed-Ali Al-Zabidi, P.Eng. MBA,PMP

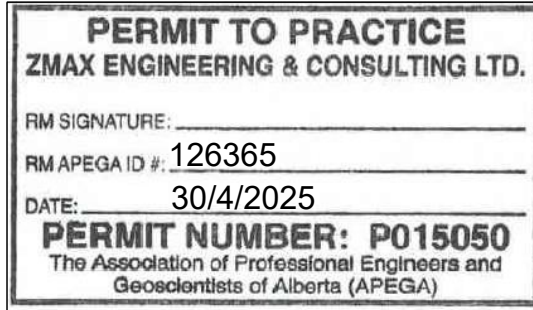

SEAL:



TITLE:

HVAC PLAN

CLIENT/PROJECT:

Kidzonia Childcare Centre
Unit14-100 Real Martin Dr.
Fort McMurray,AB

DATE: 30 April 2025

DESCRIPTION:
Issue For BP:

REVISION#
02

SCALE

1:100

PAGE NO:

M300

PREPARED BY: OK
APPROVED BY: MA



Watermarkly