
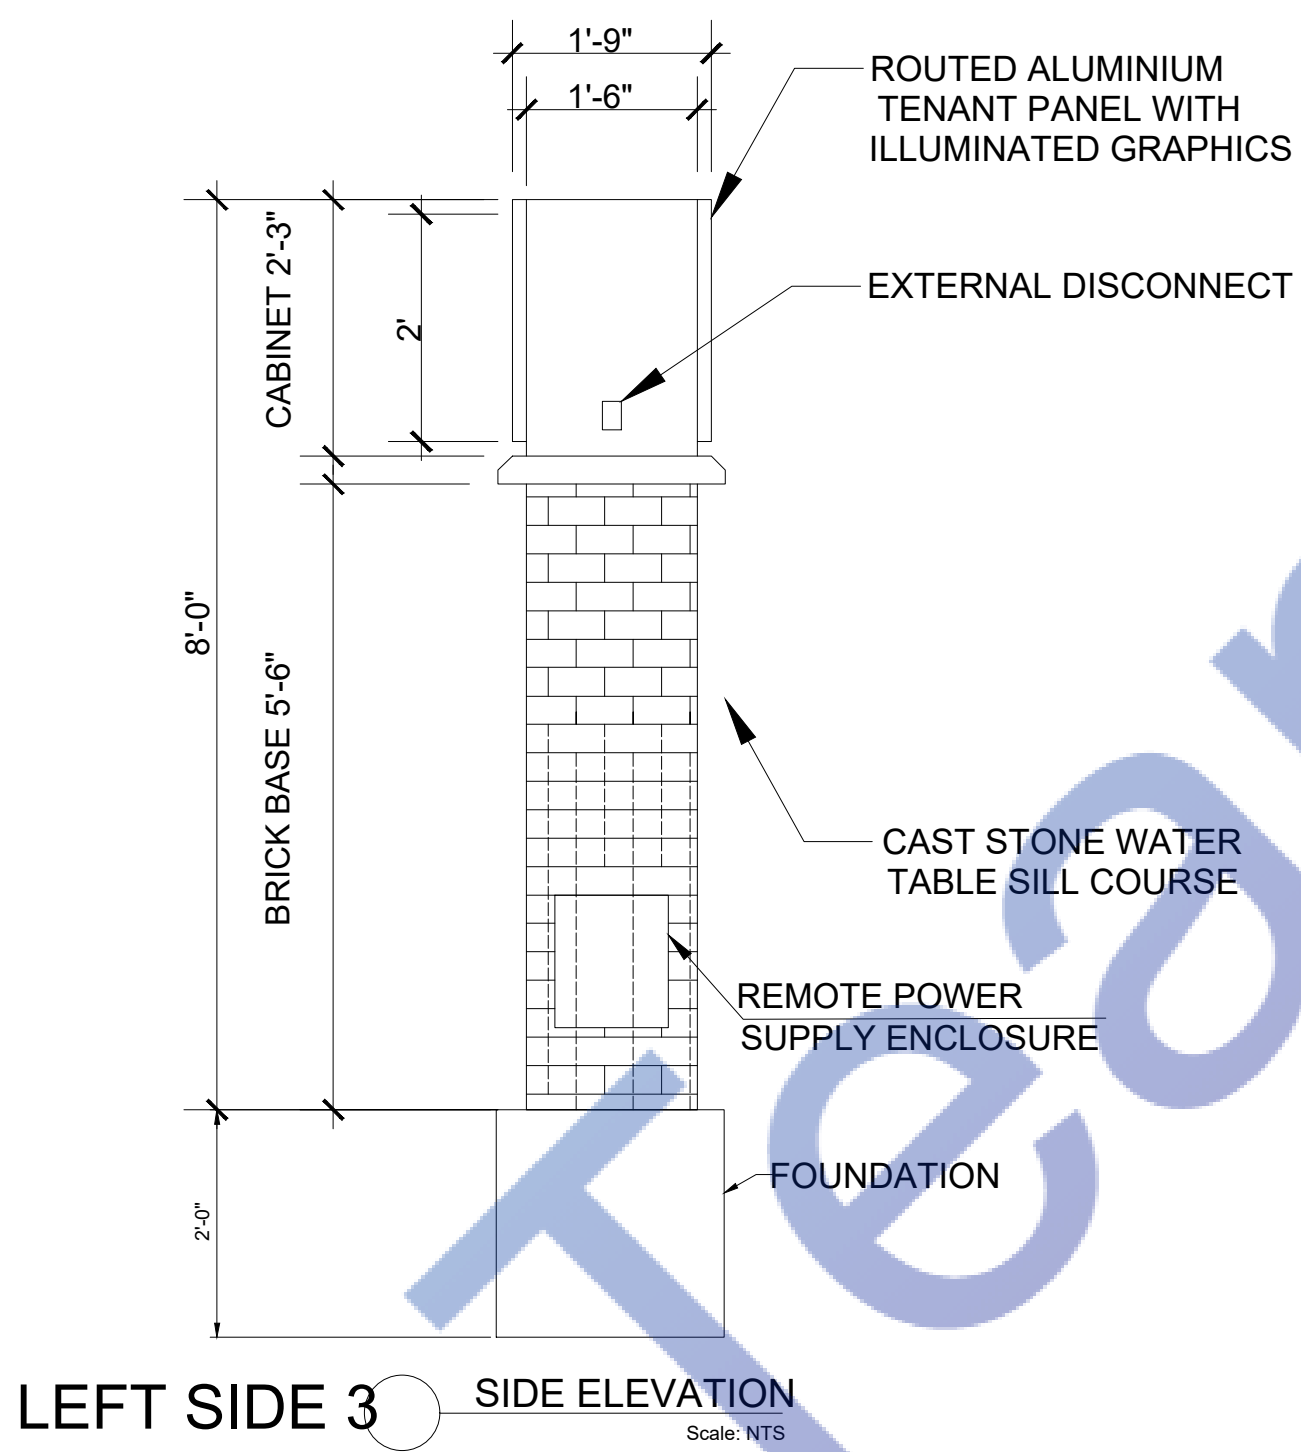


© 2023, AMERICAN SURVEYING & MAPPING, INC. ALL RIGHTS RESERVED. REPRODUCTION OR COPYING OF THIS DOCUMENT MAY BE A VIOLATION OF COPYRIGHT LAW UNLESS PERMISSION OF THE AUTHOR AND/OR COPYRIGHT HOLDER IS OBTAINED.

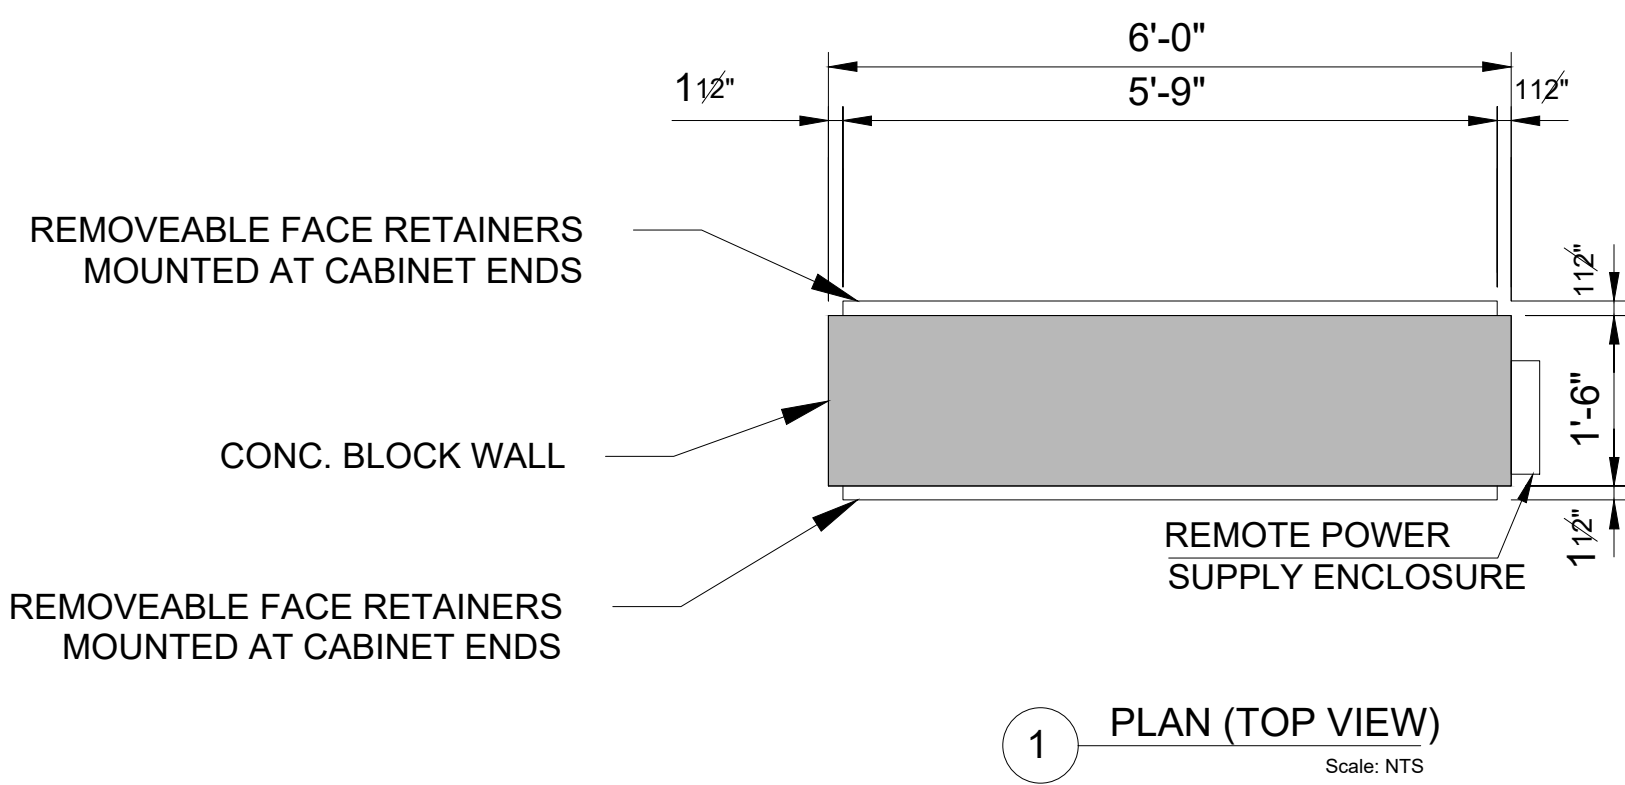

Voltage Drop Calculation

$$VD = (2 \times K \times I \times D) / CM$$

Where,

- Distance (K) (assume 170 ft one-way) = 340 ft round trip
- Current (I) = 0.775 A
- Conductor = #12 Cu → Resistance (D) ≈ 1.93 Ω/1000ft
- Voltage = 110v




$$VD_Volts = (length_ft \times current_a \times resistance_ohm_per_1000ft) / 1000$$

$$VD = (2 \times 170 \times 0.775 \times 1.93) / 1000 = 0.508555 V$$

$$VD_Percent = (vd_volts / voltage) \times 100$$

$$\%VD = (0.508555 / 110) \times 100 \approx 0.46\%$$

- Voltage Drop: ≈ 0.51 Volts
- Percentage Drop: ≈ 0.46%
- Acceptable (NEC <3%)

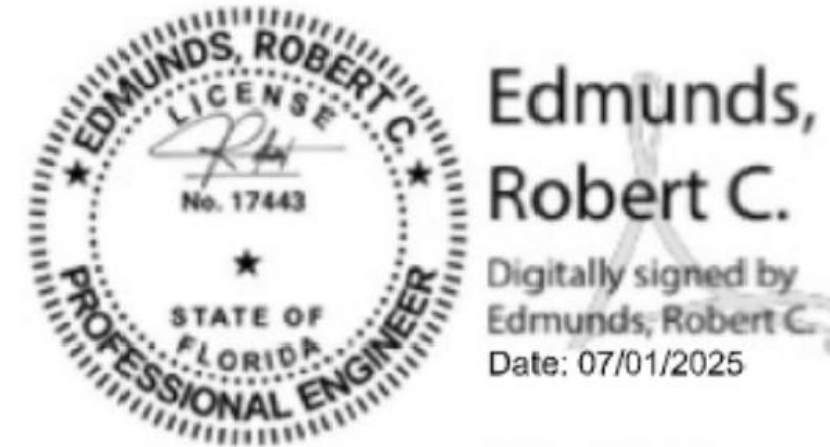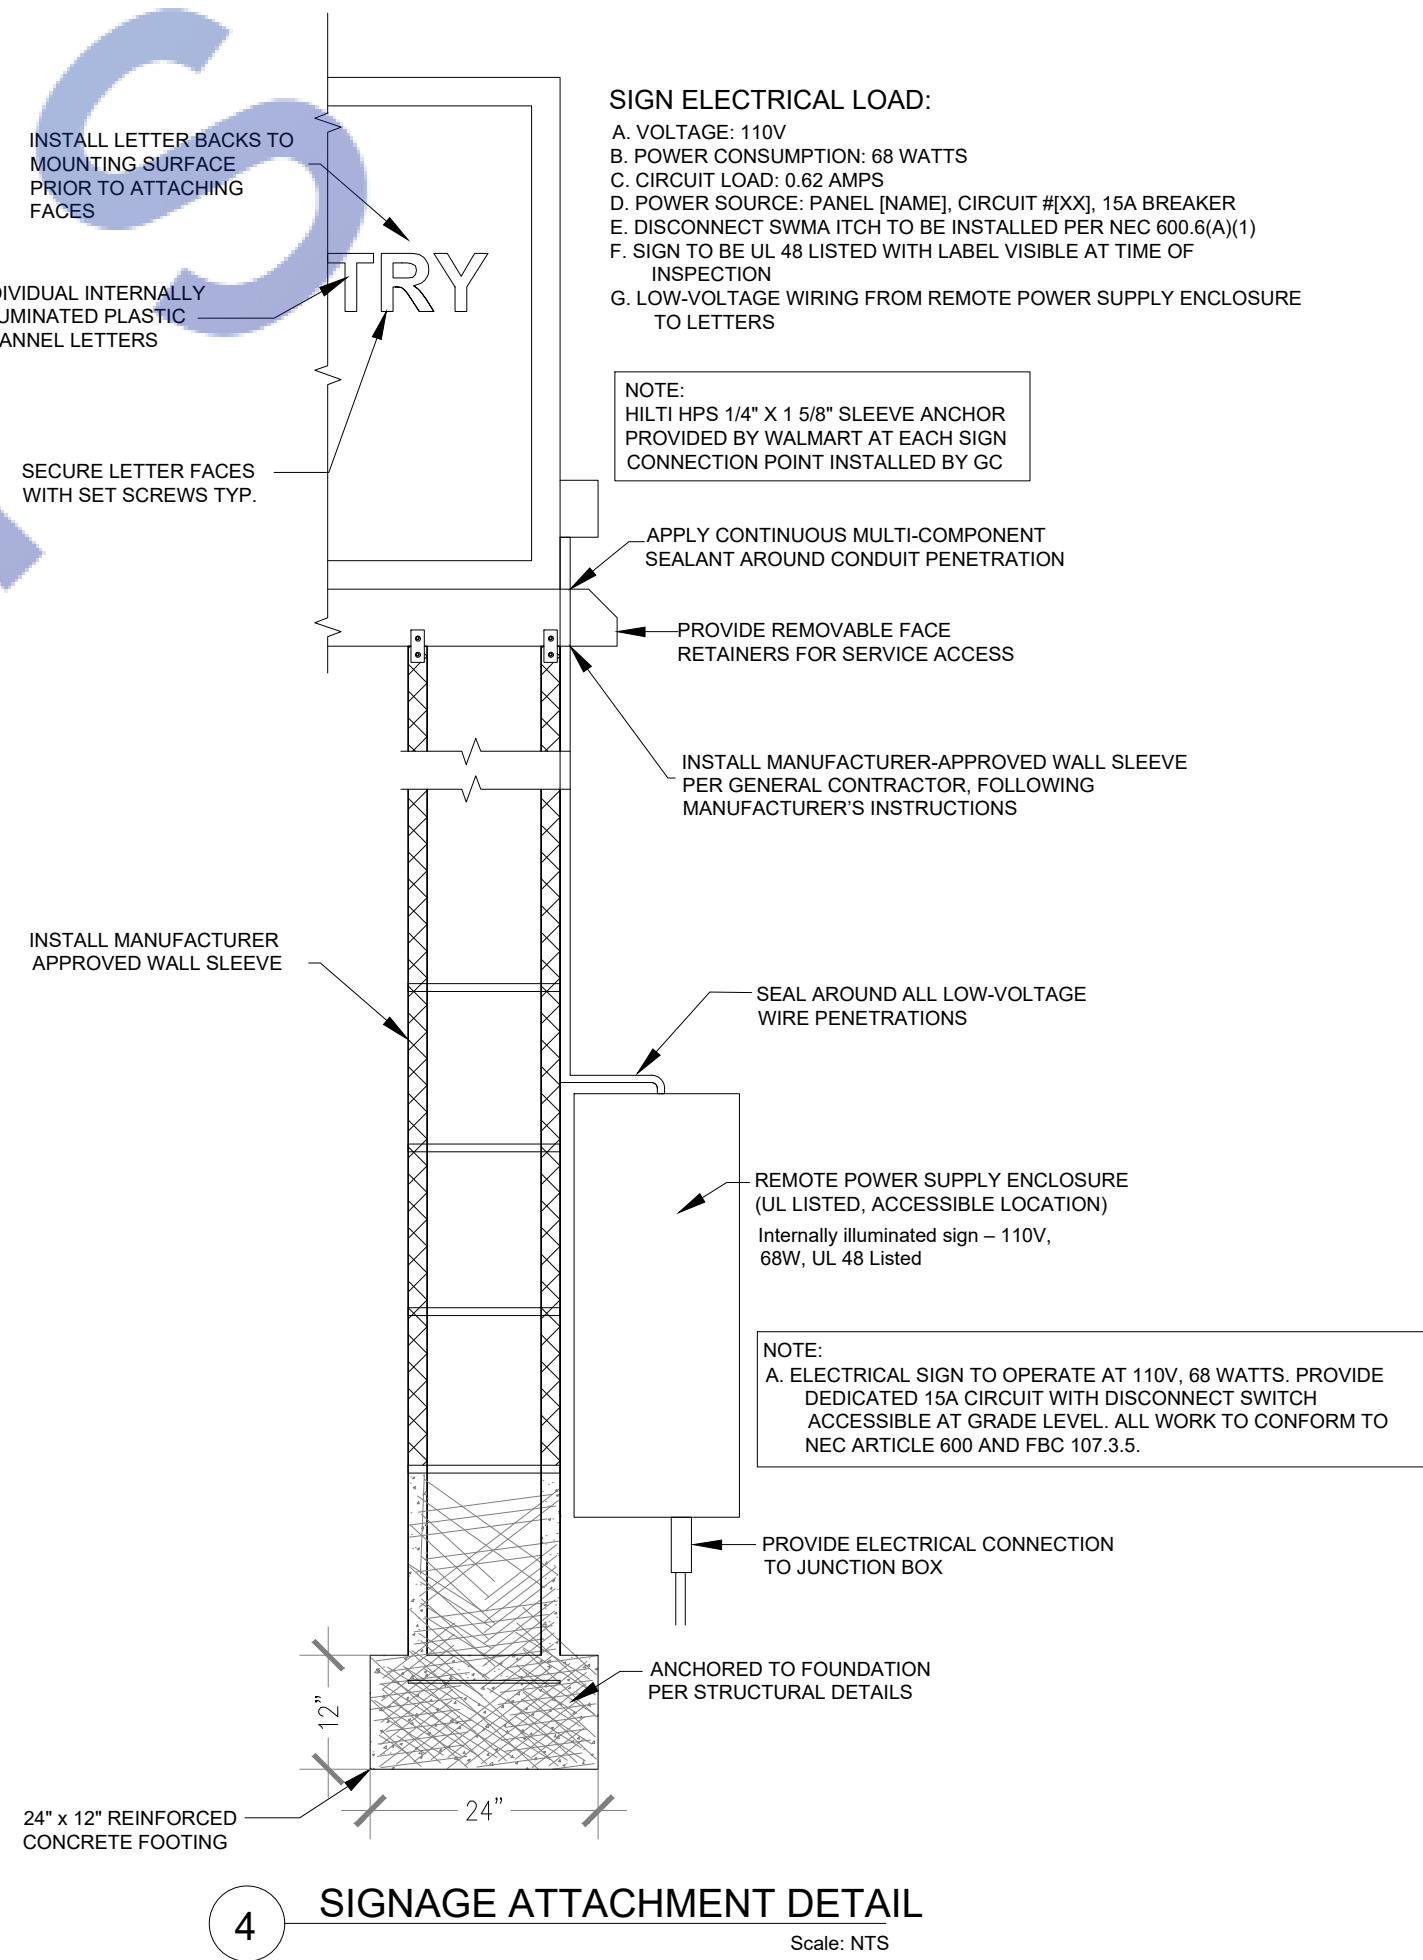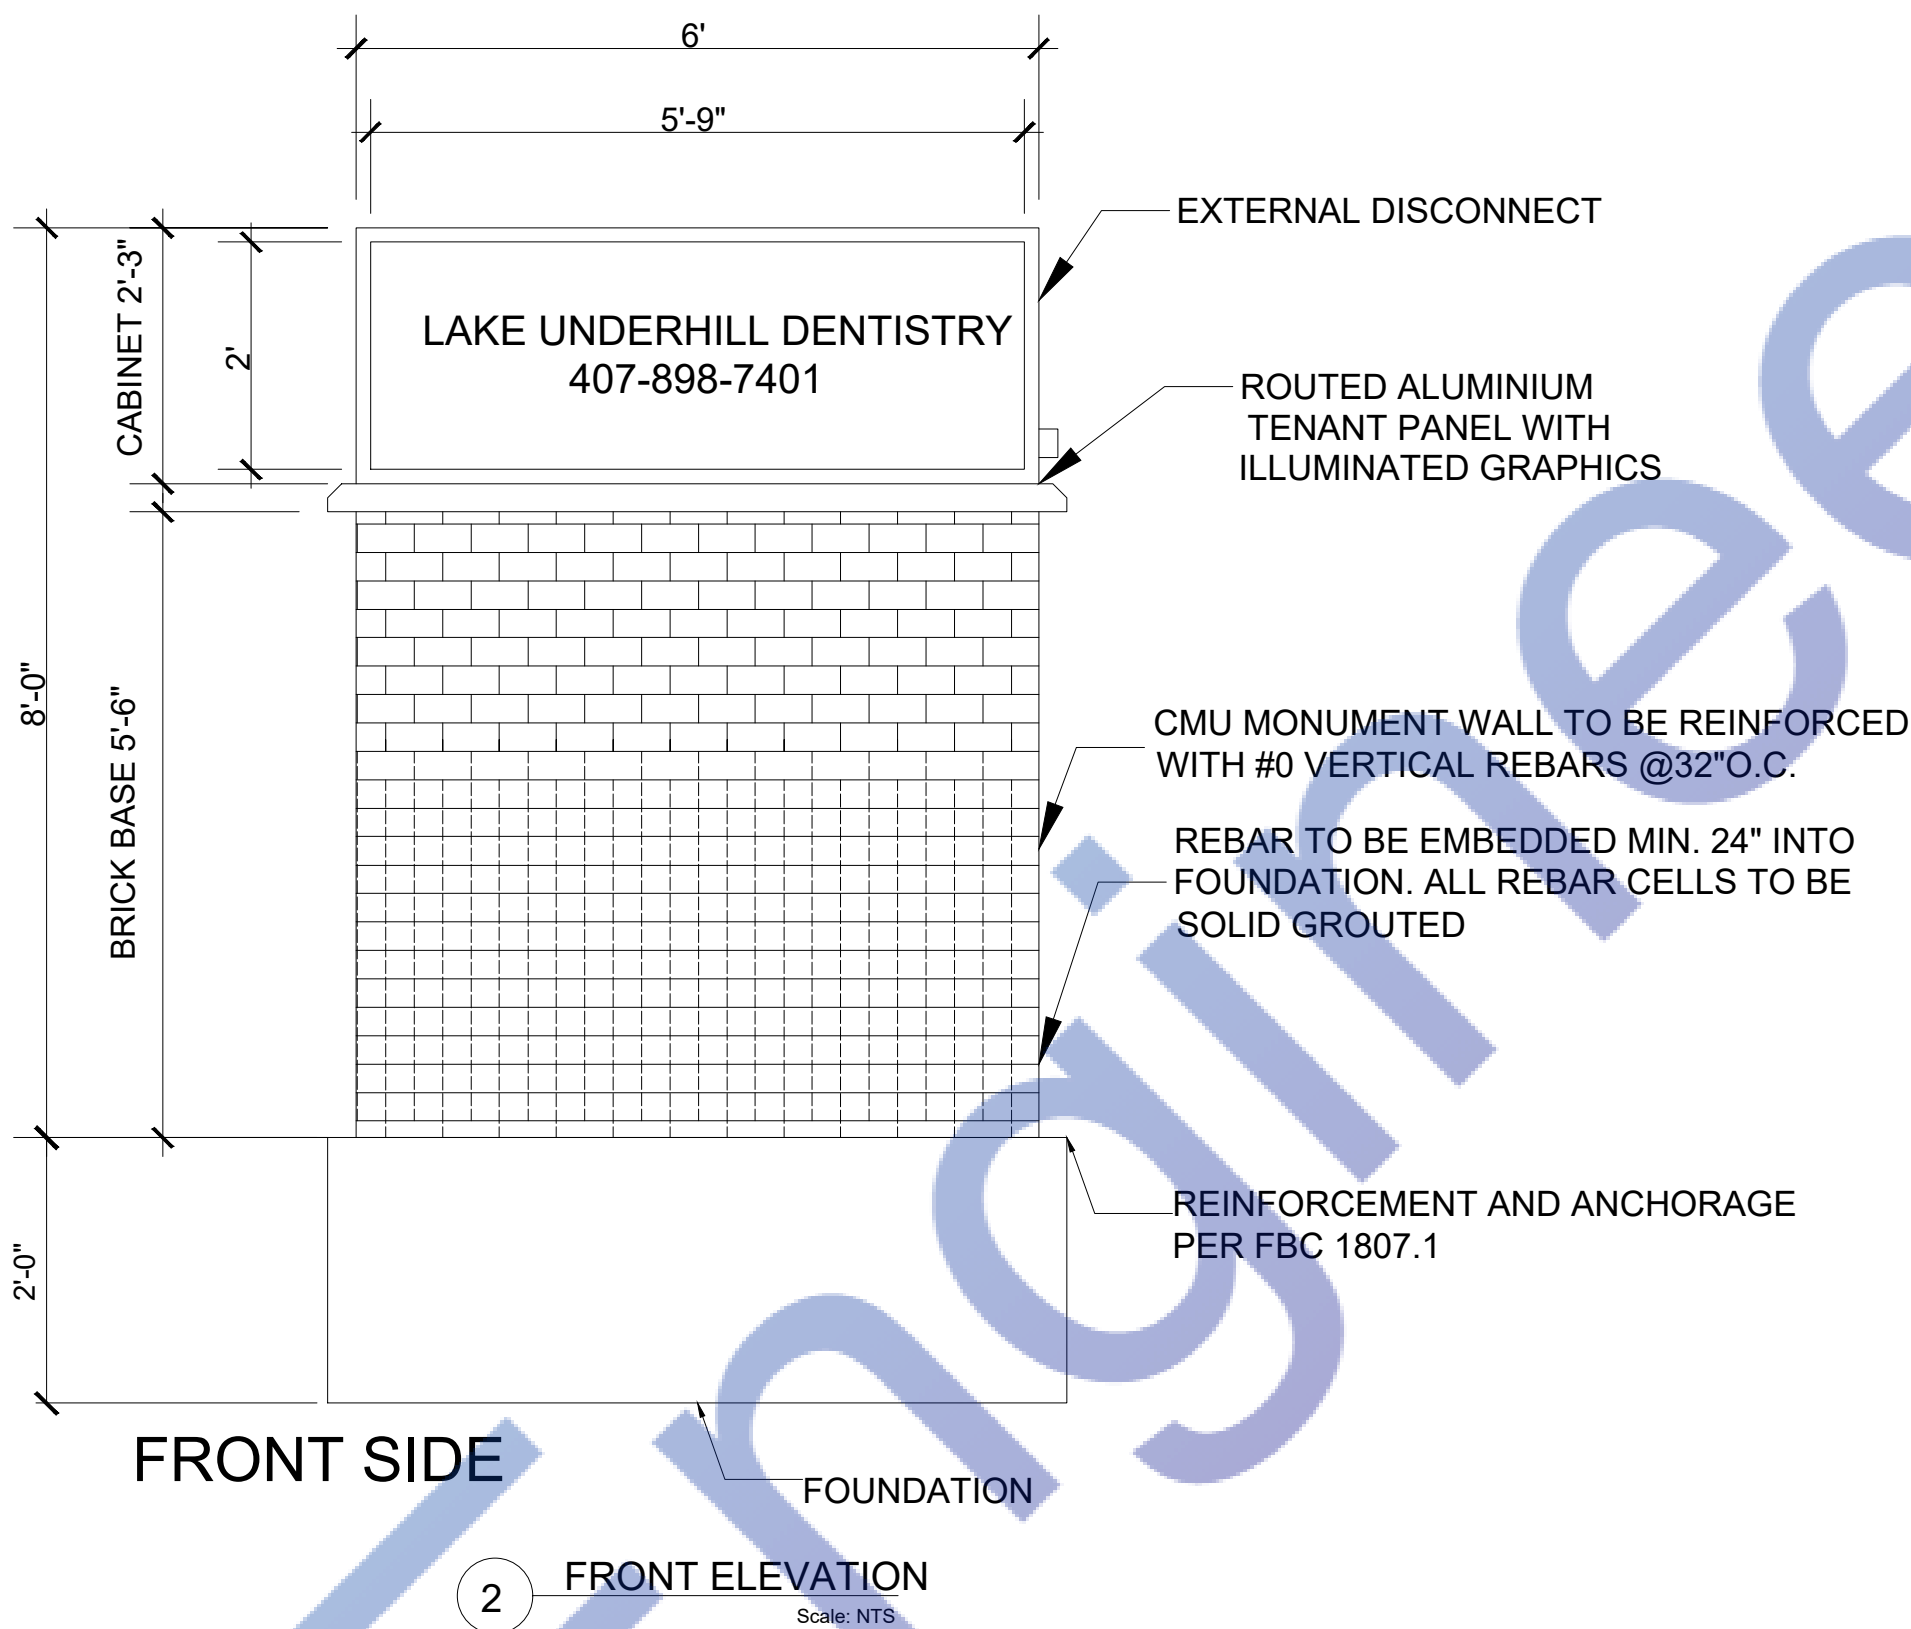

REVISION		DATE
0.		
ROJ.	ORLANDO, FL 32803 4396 LAKE UNDERHILL RD,	
TLE.	TITLE SHEET	
JOP BY	RMJM EXPERT ORGANIZATION Cell +92-321-2266110 email: rmjmexpo@gmail.com	
ATE.	DRWN. U.A.	JOB NO. U.A.
06-18-2025	CH'D. U.A.	DWG. NO. EL-01
		REV.



Designed By Engr. Al Amin (MEP Engineer | Director - Engineer's Team LTD)

 support@engrteam.com

 <https://engrteam.com>

OUR SERVICES:

- MEP Plan Services
- HVAC Layout Plan
- Electrical Engineering Services
- Plumbing Engineering Services
- Fire protection & Security systems
- Specialized services

INFORMATION:

- Studio
- Contact Us
- Gift cards
- Privacy Policy
- Refund Policy
- Delivery Policy