


Mechanical Legends	
	AIR HANDLING UNIT
	OUTDOOR CONDENSER
	SUPPLY AIR DIFFUSER
	EXHAUST AIR DIFFUSER
	KITCHEN CHIMNEY
	EXHAUST FAN
	SUPPLY AIR DUCT

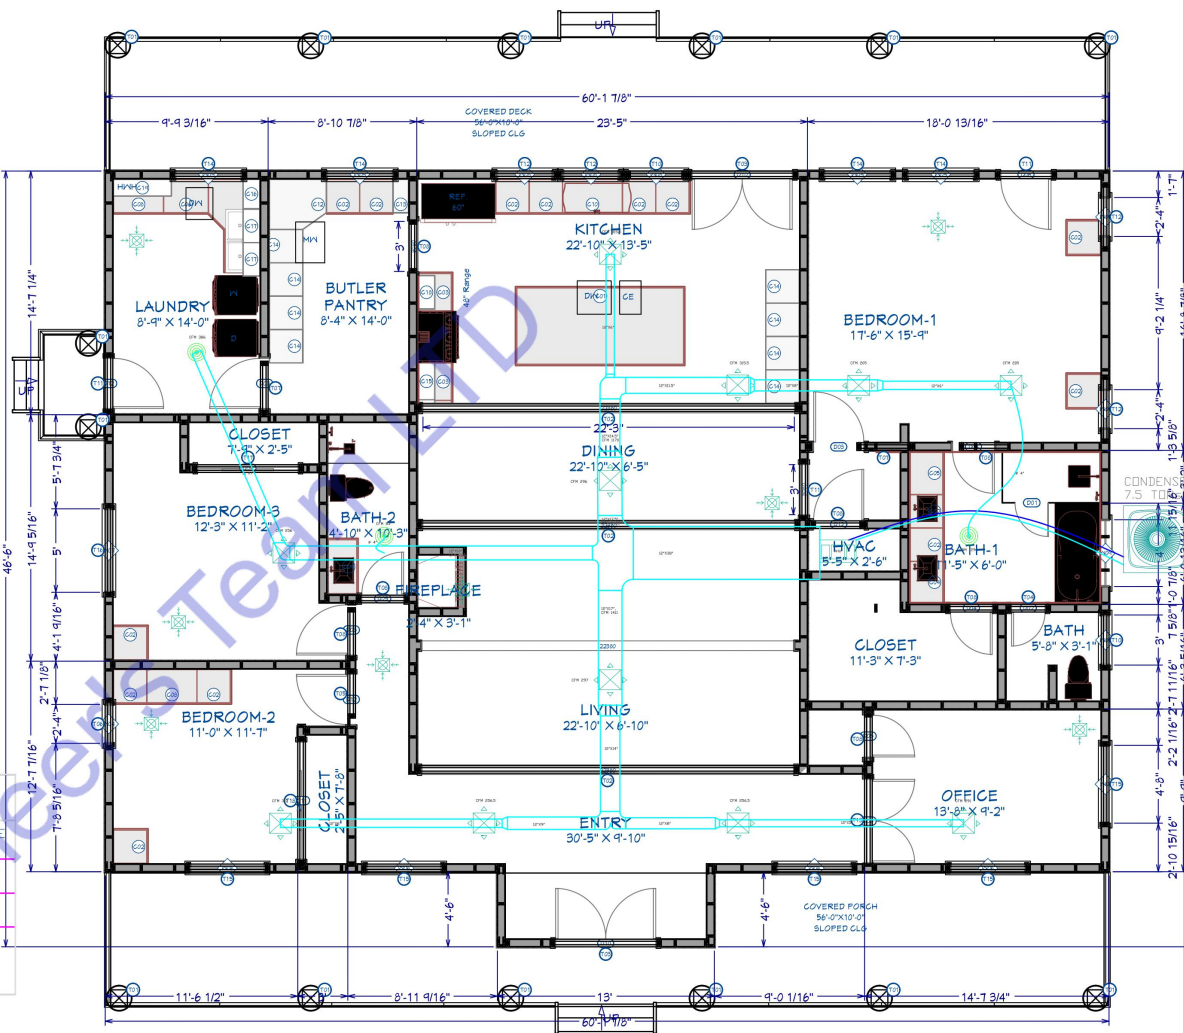

HVAC PLAN
HOUSE PLAN
3521 SQ FT

EXHAUST FAN SCHEDULE									
MARK	SERVING	CFM	SP	WATTS	RPM	VOLTAGE	MAKE MODEL	NOTES	FAN TYPE
EF-1	BATHROOM	50	-	50	460	120/60/1	Broan-NuTone 688		IN-LINE
EF-2	KITCHEN	375	-	78	460	120/60/1	Broan-NuTone BCSQ130SS		IN-LINE
NOTES 1. COMPLETE W/BACKDRAFT DAMPER. 2. PROVIDE THERMOSTATIC CONTROL DEVICES 3. INTERLOCK TO OPERATE WHENEVER RTU'S OPERATE 4. MAINTAIN A MINIMUM CLEARANCE OF 10'-0" FROM ALL INTAKE AIR FANS AND ALL ROOF TOP UNITS OUTSIDE AIR INTAKE OPENINGS.									

PROJECT TITLE	DRAWING TITLE	LOCATION	LEVEL	DRAWN BY	DATE	SCALE	REVISION :	REMARKS :	APPROVED BY :
CLASIC HOUSE	HVAC PLAN	Dublin Independent School District, TX, USA	GROUND FLOOR	MD AL AMIN	07/10/2024	A3	NO DATE DESCRIPTION DRAWN		NAME : DATE :
						NO. A13			



PROJECT TITLE	DRAWING TITLE	LOCATION	LEVEL	DRAWN BY	DATE			REVISION :			REMARKS :	APPROVED BY :	
CLASIC HOUSE	HVAC PLAN	Dublin Independent School District, TX, USA	GROUND FLOOR	MD AL AMIN	07/10/2024	SCALE	A3	NO	DATE	DESCRIPTION	DRAWN		NAME : DATE :
						NO. A13							



Designed By Engr. Al Amin (MEP Engineer | Director - Engineer's Team LTD)

 support@engrteam.com

 <https://engrteam.com>

OUR SERVICES:

- MEP Plan Services
- HVAC Layout Plan
- Electrical Engineering Services
- Plumbing Engineering Services
- Fire protection & Security systems
- Specialized services

INFORMATION:

- Studio
- Contact Us
- Gift cards
- Privacy Policy
- Refund Policy
- Delivery Policy