

 RACEWAY CONCEALED IN CEILING CAVITY, SLAB, OR WALL.
 RACEWAY HOMERUN TO PANEL, ONE ARROWHEAD PER CIRCUIT.
 RACEWAY WITH 3 WIRES #12 AWG IN CONDUIT AND #12 AWG GROUNDING CONDUCTOR. NOTE: NUMBER OF CROSS HATCHES INDICATES NUMBER OF #12 AWG CONDUCTORS SHORT CROSS HATCH = PHASE CONDUCTOR. LONG CROSS HATCH NEUTRAL CONDUCTOR. DOT INDICATES GROUNDING CONDUCTOR AND SMALL HATCHES AFTER NEUTRAL CONDUCTOR REPRESENT SWITCHED CONDUCTORS. NO CROSS HATCHES INDICATES 2 #12 AWG AND #12 AWG GROUNDING CONDUCTOR.
 WALL SWITCH, SINGLE POLE, SINGLE THROW, MOUNT 48" AFF.
 WALL SWITCH, 3-WAY, SINGLE POLE, DOUBLE THROW, MOUNT 48" AFF.
 WALL VACUANCY SENSOR SWITCH, SINGLE POLE, MOUNT 48" AFF.
 DISCONNECT SWITCH, SIZE/POLES/FUSE/ENCLOSURE TYPE IF OTHER THAN NEMA 3R, MOUNT 48" AFF. "HF" INDICATES NON-FUSED TYPE (30/3/20/3R).
 DUPLEX RECEPTACLE
 DUPLEX RECEPTACLE - BOTTOM HALF SWITCHED
 DUPLEX RECEPTACLE - FLOOR MOUNTED
 RECEPTACLE - 220V
 DUPLEX RECEPTACLE - GROUND FAULT INTERRUPT
 DUPLEX RECEPTACLE - WEATHER PROOF AND GROUND FAULT INTERRUPT
 SMOKE DETECTOR - WIRED IN SERIES
 CARBON MONOXIDE DETECTOR
 COMBINATION SMOKE AND CARBON MONOXIDE DETECTOR.
 EXHAUST FAN MOTOR
 EXHAUST FAN MOTOR WITH LIGHT
 JUNCTION BOX, ABOVE CEILING.
 JUNCTION BOX, WALL-MOUNTED.
 PANELBOARD, SURFACE-MOUNTED MOUNT AT 6'-0" TO TOP.
 UTILITY SERVICE METER
 DOOR BELL PUSH BUTTON.
 DOOR BELL.
 CEILING FAN I PHASE, 120 VOLT, SINGLE POLE, 60HZ.

- A. ALL ELECTRICAL WORK SHALL CONFORM TO NEC 2017 AND VIRGINIA RULES AND REGULATION.
- B. ALL EQUIPMENT SHALL BE NEW AND ULL APPROVED.
- C. ELECTRICAL DRAWINGS ARE DIAGRAMMATIC. SIZE AND LOCATION OF EQUIPMENT AND WIRING ARE SHOWN TO SCALE. THE BIDDER MAY GOVERN THE LOCATION OF THE FINAL LOCATION OF THE EQUIPMENT.
- D. OUTLETS AND EQUIPMENT SHALL BE SHOWN IN ENLARGED DETAILS OR AS APPROVED BY THE ARCHITECT OR HIS REPRESENTATIVE.
- E. IT IS NOT WITHIN THE SCOPE OF DRAWINGS TO SHOW ALL THE NECESSARY BENDS, OFFSETS, PULLBOXES AND OTHERS. THE BIDDER SHALL BE RESPONSIBLE FOR THE INSTALLATION OF WIRING TO CONFORM TO THE STRUCTURE, MAINTAIN HEAD-ROOM AND KEEP OPENINGS AND PASSAGEWAYS CLEAR. REFER TO THE ARCHITECTURAL DRAWINGS FOR DIMENSIONS.
- F. THE CONTRACTOR SHALL CAREFULLY EXAMINE THE SITE AND SHALL COMPARE THE DRAWINGS WITH EXISTING ELECTRICAL INSTALLATIONS AND EQUIPMENT OF FAMILY. SHALL WIRE WITH ALL EXISTING CONDITIONS WITHIN THE SCOPE OF HIS WORK. BY THE ACT OF SUBMITTING A BID, THE CONTRACTOR WILL HAVE DEEMED TO HAVE MADE SUCH EXAMINATION AND TO HAVE ACCEPTED SUCH CONDITIONS AND TO HAVE MADE ALLOWANCE THEREFORE.
- G. IN FURNISHING HIS BID, CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE WITH ALL TRADES AND ELECTRICAL REFERENCES ON ARCHITECTURAL DRAWINGS.
- H. VERIFY LOCATIONS OF ALL ELECTRICAL EQUIPMENT WITH ARCHITECTURAL DRAWINGS AND INTERIOR DETAILS AND FINISHES. IN CENTERING OUTLETS AND LOCATING BOXES AND OUTLETS, ALLOW FOR OVERHEAD PIPES, DUCTS, AND VENTILATION EQUIPMENT. PROVIDE FOR PROTECTING EXISTING FIREWORKS AND PLASTERING. PROVIDE FOR FLOORING, FLOOR CEILINGS AND THE LIKE, AND CORRECT ANY INACCURACY RESULTING FROM FAILURE TO DO SO WITHOUT EXPENSE TO OWNER.
- I. FURNISH AND INSTALL WIRING FOR EQUIPMENT FURNISHED BY OTHERS, AS SHOWN ON DRAWINGS, COORDINATE WITH OTHER TRADES OR DETAILS FOR INSTALLATION. THE TERM "WIRING" AS USED HEREIN, INCLUDES FURNISHING AND INSTALLING CONDUIT, WIRE AND MAKING CONNECTIONS AND MAKING CONNECTIONS AND WIRING RESPONSIBLE FOR PROPER WIRING AND NECESSARY ELECTRICAL ADJUSTMENTS TO EQUIPMENT TO CONFORM TO SPECIFIED REQUIREMENTS OF THE EQUIPMENT.
- J. SECURE AND PATCH ALL PERFS AND CUTS NECESSARY FOR EXECUTION AND COMPLETION OF ELECTRICAL WORK.
- K. THE CONTRACTOR SHALL DO ALL CUTTINGS AND PATCHING OF THE EXISTING CONSTRUCTION WORK WHICH MAY BE REQUIRED FOR THE PROPER INSTALLATION OF THE ELECTRICAL WORK. ALL PATCHING SHALL BE OF THE SAME MATERIALS, WORKMANSHIP, AND FINISH AND SHALL ACCURATELY MATCH ALL SURROUNDING WORK.
- L. AFTER COMPLETION OF WORK UNDER THIS SECTION, CLEAN UP RESULTANT DEBRIS FROM THIS WORK AND REMOVE FROM SITE.
- M. CODE REQUIREMENTS ARE MINIMUM AND SHALL BE COMPLIED WITH AT NO ADDITIONAL COST TO THE OWNER. WHERE REQUIREMENTS OF THESE DRAWINGS EXCEED CODE REQUIREMENTS, WORK SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE DRAWINGS.
- N. MATERIALS FROM MANUFACTURERS, METHODS AND PROCEDURES SET FORTH HEREIN MUST BE APPROVED IN WRITING. APPROVAL WILL NOT BE GIVEN UNLESS THE PROPOSED SYSTEM IS EQUAL IN PERFORMANCE, DURABILITY, LONGEVITY, AND RELIABILITY TO THAT SPECIFIED.

A. INSTALL LIGHTING FIXTURES AS SHOWN ON THE ELECTRICAL DRAWINGS. VERIFY EXACT LOCATIONS OF FIXTURES WITH ARCHITECTURAL REFLECTED CEILING PLANS. COORDINATE FIXTURE HOUSINGS AND TRIMS WITH CEILING TYPE. PROVIDE REQUIRED ACCESSORIES FOR CEILING TYPES.

B. ALL RECESSED LIGHTING FIXTURES SHALL BE LED.

C. ALL BULBS ARE DIMMABLE LED.

D. NUMBER OF BULBS DETERMINED BY FIXTURE CHOSEN BY CUSTOMER.

E. KIDNATED RECESSED LIGHT FIXTURES SHALL BE SEALD AT HOUSING/INTERIOR FINISH AND LABELED TO INDICATE.

F. 2.0 CFM LEAKAGE AT 75% PA, (2016 VA ENERGY CODE) 75% LAMPS IN PERMANENT FIXTURES OR 75% PERMANENT FIXTURES SHALL BE USE HIGH EFFICY LAMPS. (2016 VA ENERGY CODE)

A. ALL PANELBOARDS SHALL BE ENCLOSED TYPE, FLUSH OR SURFACE MOUNTED AS REQUIRED, IN STEEL CABINETS CODE GAUGE, WITH STEEL TRIM CONCEALED HINGES, DOORS AND FLUSH TYPE LOCKS. MANUFACTURER SHALL BE APPROVED BY D. C. URS CORP. ITS TYPE SHALL BE APPROVED BY THE A.E.C.

B. ALL BUSSES, INCLUDING NEUTRAL AND GROUND BUS, SHALL BE MINIMUM 40% CONDUCTIVITY, HARD DRAWN COPPER, SILVER OR TIN-PLATED FLATS, AND SIZED ON THE BASIS OF 1000 AMPERES PER SQUARE INCH CROSS-SECTIONAL AREA. BUSSES SHALL BE ARRANGED FOR SEQUENCING PHASING. EXCEPTION: ALUMINUM BUSSES ARE PERMITTED FOR RESIDENTIAL LOAD CENTER PANELBOARDS.

C. PANELBOARDS SHALL BE EQUIPPED WITH PLUG-ON MOLDED CASE CIRCUIT BREAKERS OF THE TYPE, NUMBER OF POLES, TRIP SIZES, AS SHOWN IN DRAWINGS AND INTERRUPTING CAPACITY AS PER BUILDING REQUIREMENTS. RESIDENTIAL UNITS SHALL BE EQUIPPED WITH PLUG-IN TYPE MOLDED CASE CIRCUIT BREAKERS FOR ALL MAINS AND SUBMAINS, TRIP SIZES, AS SHOWN IN DRAWINGS AND INTERRUPTING CAPACITY AS PER BUILDING REQUIREMENTS. GROUP AND LACE ALL CONDUCTORS WITHIN PANEL ENCLOSURE DO NOT SPLICE CONDUCTORS WITHIN PANEL ENCLOSURE.

D. SEAL EXISTING PANEL KNOCKOUTS NOT RE-USED.

E. DISCONNECT SWITCHES SHALL BE SQUARE-D D CLASS 310 TYPE FUSED OR NON-FUSED, OR APPROVED EQUIVALENT.

DUPLEX RECEPTACLES FOR WALL AND FLOOR CONVENIENCE OUTLETS SHALL BE 2 POLE, 3 WIRE, GROUNDED, 15 AMPERE, NEMA CONFIGURATION 5-20R, COLOR BY ARCHITECT.
ALL RECEPTACLES SHALL BE TAMPER RESISTANT.
DUPLEX 6FI RECEPTACLE SHALL BE 2 POLE, 3 WIRE, GROUNDED, 20 AMPERE, NEMA CONFIGURATION 5-20R, COLOR BY ARCHITECT.
SINGLE POLE SWITCHES AND 3-WAY SWITCHES SHALL BE SPECIFICATION GRADE. COLOR BY ARCHITECT. DEVICE SHALL BE MOUNTED UNDER COMMON COVERPLATE WHERE MULTIPLE DEVICES ARE INDICATED.
ALL WIRE WORK SHALL BE INSTALLED ACCORDING TO NFPA 72.
AC/BATTERY, THESE SHOULD CONFORM TO THE NFPA 72, SECTION 24.6 ALARM'S HAVE TWO POWER SUPPLIES 120- VOLT AC FOR THE PRIMARY SOURCE OF POWER AND BATTERY BACKUP FOR THE SECONDARY SOURCE.

A. ALL BRANCH CIRCUIT CONDUCTOR'S SHALL BE COPPER UNLESS OTHERWISE NOTED. ALL #8 AWG WIRE AND LARGER SHALL BE STRANDED.

B. ALL #10 AWG WIRE AND SMALLER SHALL BE SOLID.

C. VOLTAGE RATINGS OF INSULATION SHALL BE 600 VOLTS.

D. FACTORY COLOR CODINGS FOR WIRE AND CABLE SHALL BE AS FOLLOWS: 120/208V - BLACK, RED, BLUE AND WHITE, FOR PHASES, A, B AND C, RESPECTIVELY. GROUND WIRES SHALL BE GREEN.

E. LEAD WIRE SUFFICIENTLY LONG TO PERMIT MAKING FINAL CONNECTIONS.

F. LIGHTING AND POWER WIRING FOR CIRCUITS LESS THAN 100 FEET SHALL BE #12 AWG, UNLESS NOTED. WIRE SIZES SHALL BE #10 FOR CIRCUITS GREATER THAN 100 FEET.

A. TYPE NM CABLE SHALL BE PERMITTED PER NFPA-70 ARTICLE 334.10. ALL OTHER LOCATIONS SHALL USE TYPE MC AS A SUBSTITUTE FOR CONDUIT.

A. ALL OUTLET BOXES SHALL BE PLASTIC RATED FOR RESIDENTIAL USE.
B. ALL OUTLET BOXES SHALL BE PLASTIC RATED FOR RESIDENTIAL USE. THE PLASTIC RATED BOXES SHALL BE 4" SQUARE, BY 1-1/2" MINIMUM DEPTH AND SHALL BE FITTED WITH DEVICE COVERS AND DEPTH EQUAL TO THE DRY WALL THICKNESS.
C. SECTIONAL BOXES ARE NOT ACCEPTABLE.
D. FINISH WALLS AND TRUE BUILDING FINISH. ERECT WALL AND SWITCH OUTLETS IN ADVANCE OF FURRING AND FIREPROOFING.
E. LOCATIONS INDICATED FOR LOCAL WALL SWITCHES ARE SUBJECT TO MODIFICATIONS. AT OR NEAR DOORS INSTALL SWITCH, IN ADDITION TO THE LOCATION INDICATED PRIOR TO EACH OUTLET INSTALLATION.
F. LOCATION INDICATED FOR LOCAL WALL SWITCHES, CONTROLLERS, EMERGENCY PUSH BUTTONS, RECEPTACLE, ETC., ARE SUBJECT TO MODIFICATIONS.
G. SETBACK FROM FINISHED FLOOR TO CENTERLINE OF OUTLETS, AS PER ELECTRICAL DRAWINGS. EXCEPTIONS, AT JUNCTION OF DIFFERENT WALL MATERIALS, MOLDING OR BREAK IN WALL SURFACE IN VIOLATION OF CODE REQUIREMENTS.

A. GROUND ALL CONDUITS, CABINETS, MOTORS, PANELS, AND OTHER EXPOSED NON-CURRENT CARRYING METAL PARTS OF ELECTRICAL EQUIPMENT IN ACCORDANCE WITH ALL PROVISIONS OF THE NATIONAL ELECTRICAL CODE, OR LOCAL CODES THAT MAY APPLY.

A. ALL PENETRATIONS THROUGH FIRE RATED WALLS, FLOORS OR PARTITIONS SHALL BE SEALED TO PREVENT THE SPREAD OF SMOKE AND FIRE THROUGH THEM. THE FIRE RATINGS OF THE PENETRATION SEAL SHALL BE AT LEAST THAT OF THE FLOOR OR WALL INTO WHICH IT IS INSTALLED BY ARTICLE #9000-21 OF THE NATIONAL ELECTRICAL CODE.

B. THE FOAM SEALANT SHALL MEET ALL OF THE FIRE TEST AND HOUSE STREAM TEST REQUIREMENTS OF ASTM E-119-73 AND SHALL BE UL CLASSIFIED AS A WALL OPENING PROTECTIVE DEVICE, AS MANUFACTURED BY CHASE TECHNOLOGY CORPORATION, OR APPROVED EQUIVALENT.

A. MECHANICAL CONTRACTOR SHALL FURNISH AND INSTALL CONTROL WIRING INCLUDING CONDUITS, RELAYS, TIME CLOCK, CONTROL TRANSFORMERS, ETC., FOR ALL HVAC EQUIPMENT, UNLESS OTHERWISE NOTED.

B. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ONLY POWER WIRING WITH DISCONNECTS, AS SHOWN IN ELECTRICAL DRAWINGS.

A. UPON COMPLETION OF ALL ELECTRICAL WORK, CONTRACTOR SHALL TEST FOR GROUNDS AND SHORTS, TO ENSURE PROPER OPERATION OF ELECTRICAL EQUIPMENT.

B. GUARANTEE FOR TWO YEARS AFTER FINAL ACCEPTANCE BY OWNER OF ALL WORKMANSHIP AND MATERIALS FURNISHED.

C. SMOKE DETECTOR TEST SHOULD BE DONE IN ACCORDANCE WITH NFPA-T2.

AIC	AMPERES INTERRUPTING CURRENT
AFF/ARF	ABOVE FINISHED FLOOR/ ABOVE RAISED FLOOR
ARCH	ARCHITECT/ARCHITECTURAL
AT	AMPERE TRIP
AF	AMPERE FRAME
C	CONDUIT
CB	CIRCUIT BREAKER
CKT	CIRCUIT
EC	EMPTY CONDUIT
EMT	ELECTRICAL METALLIC TUBING
EX	EXISTING
F	FUSED
FFL	FINISHED FLOOR
FLR	FLOOR
G	GROUND
GF	GROUND FAULT CIRCUIT INTERRUPTER
HID	HIGH INTENSITY DISCHARGE
J, JB	JUNCTION BOX
kcmil	THOUSAND CIRCULAR MILLS
MC	METAL-GLAD CABLE
MCB	MAIN CIRCUIT BREAKER
MH	METAL HALIDE
MLO	MAIN LUG ONLY
NF	NONFUSIBLE
PH	PHASE
PVC	POLYVINYL CHLORIDE CONDUIT
RECP	RECEPTACLE
RSS	RIGID GALVANIZED STEEL
SYM	SYMMETRICAL
TEL	TELEPHONE
V	VOLT
VA	VOLT-AMPERE
W	WIRE OR WATT
WP	WEATHERPROOF
XFMR	TRANSFORMER
CLG	CEILING GROUND FAULT CIRCUIT INTERRUPTER(GFCI).
A-X	A IS THE NAME OF ELECTRICAL PANEL BOARD AND X IS THE NUMBER OF CIRCUIT.


SYMBOL	FIXTURE DESCRIPTION	MOUNTING	VOLTS	INPUT WATTS	MANUFACTURER	PART #	ITEM #	REMARK
	5.5" LED DOWNLIGHT, WHITE PAINTED FLANGE, 0-10V DIMMING, 65 DEG BEM SPREAD	RECESS CEILING	120	12.5	PROGRESS LIGHTING FIXTURES	--	P910007-0 28-30K	OR EQUIVALENT APPROVED BY OWNER
	KEYLESS CEILING MOUNTED EXPOSED LED BULB	SURFACE CEILING	120	17	SPECIFIED BY OWNER FIXTURE ALLOWANCE	--	--	OR EQUIVALENT APPROVED BY OWNER
	EXTERIOR WALL MOUNT LED BULB	SURFACE WALL	120	17	PROGRESS LIGHTING FIXTURES	L0434623	F5674-31	OR EQUIVALENT APPROVED BY OWNER
	CLOSE TO CEILINGS, BOWL GLASS, LED LAMPS	SURFACE WALL	120	30	PROGRESS LIGHTING FIXTURES	L0478474	F300160- 004	OR EQUIVALENT APPROVED BY OWNER
	PENDANT FIXTURE, LED LAMPS	SURFACE CEILING	120	100	PROGRESS LIGHTING FIXTURES	L478483	F300125-0 04	OR EQUIVALENT APPROVED BY OWNER
	LIGHT FIXTURE - UNDER CABINET LED LIGHT	SURFACE CEILING	120	7	PROGRESS LIGHTING FIXTURES	L0364834	F1000000- 028-30	OR EQUIVALENT APPROVED BY OWNER

1. ALL BULBS DIMMABLE LED, LUMINAIRES SHALL BE SUPPORTED IN ACCORDANCE WITH NEC ARTICLE 410.
2. SPECIFIED LIGHT FIXTURES SHALL BE USED AS A BASIS OF DESIGN. ARCHITECT/OWNER SHALL APPROVE EXACT LIGHTING FIXTURE PACKAGE PRIOR TO BID SUBMITTAL.
3. RECESSED FIXTURES INSTALLED WITHIN FIRE RATED CEILINGS SHALL BE A UL RATED FIRE RATED HOUSING OR PROVIDED WITH FIRE RATED TENTING ASSEMBLY AROUND PERIMETER OF HOUSING. COORDINATE WITH ARCHITECTURAL FOR RATED CEILING AREAS.
4. ALL NEW LED LUMINAIRES SHALL BE EQUIPPED WITH ENERGY SAVING DRIVERS.



ELECTRICAL DRAWING LIST	
DRAWING	TITLE
E000	ELECTRICAL GENERAL NOTES, SYMBOLS, & ABBREVIATIONS
E100	ELECTRICAL BASEMENT FLOOR PLAN
E101	ELECTRICAL FIRST FLOOR PLAN
E102	ELECTRICAL SECOND FLOOR PLAN
E500	ELECTRICAL GROUNDING DETAILS
E600	ELECTRICAL PANEL SCHEDULE

THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE. © SITE SPECIFIC HAZARDS IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:	Rev	Description	Date	By	Key Plan:	Note:	Project: Kitchen & Bar			Drawing No. E-0		 ATCO Studio Design Your Way www.atcostudio.co.uk info@atcostudio.co.uk
							Client: Daka Daka			Drawing Name: General Note of Electrical Plan		
							Date: 01/01/2025	Paper Size: A3	Scale on A3: 1:100	Author: MP	Checker: AT	

BASEMENT

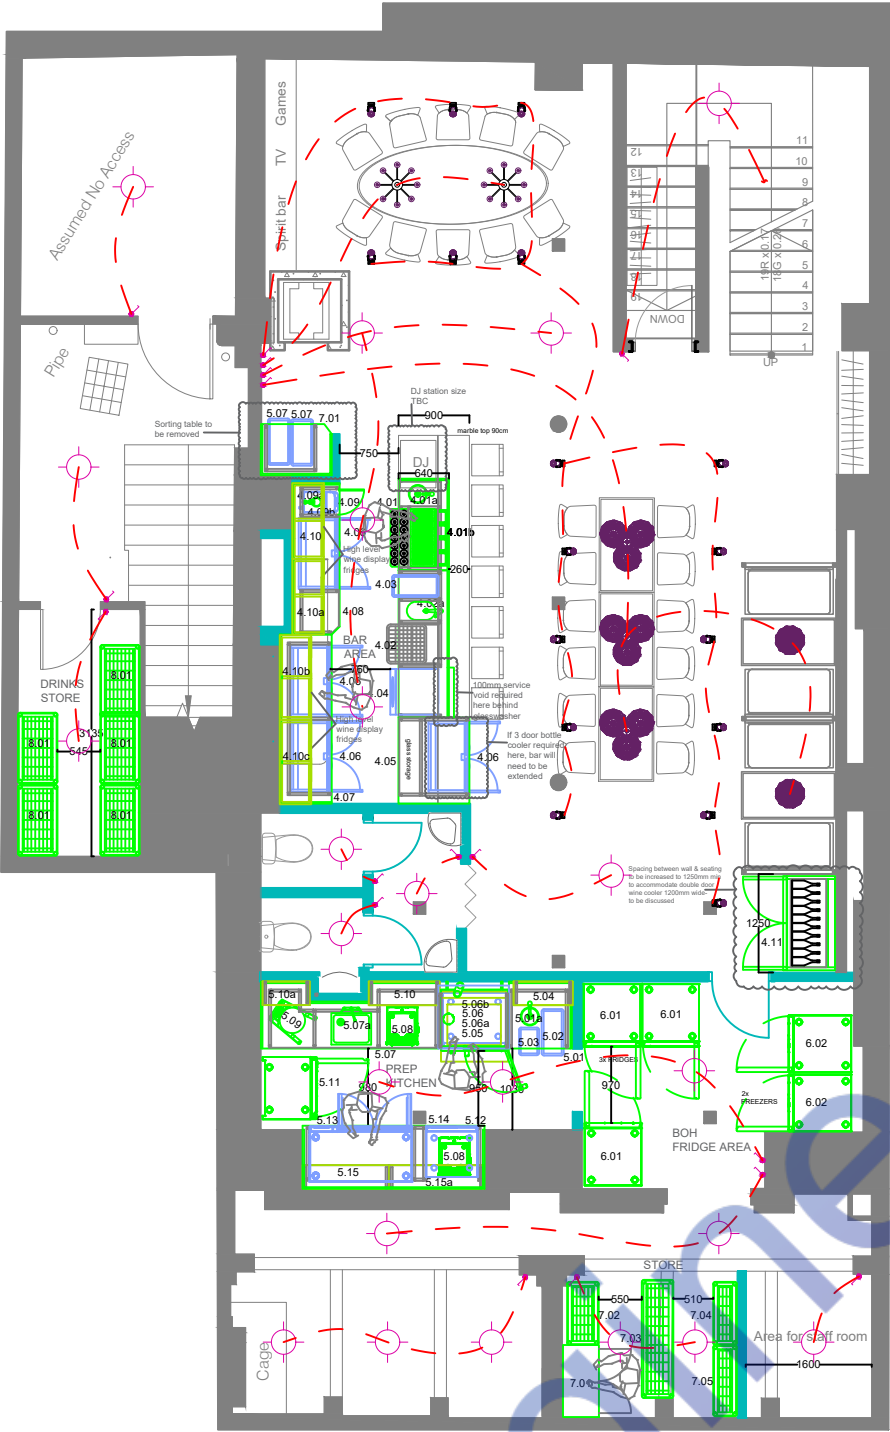

GF Option 1

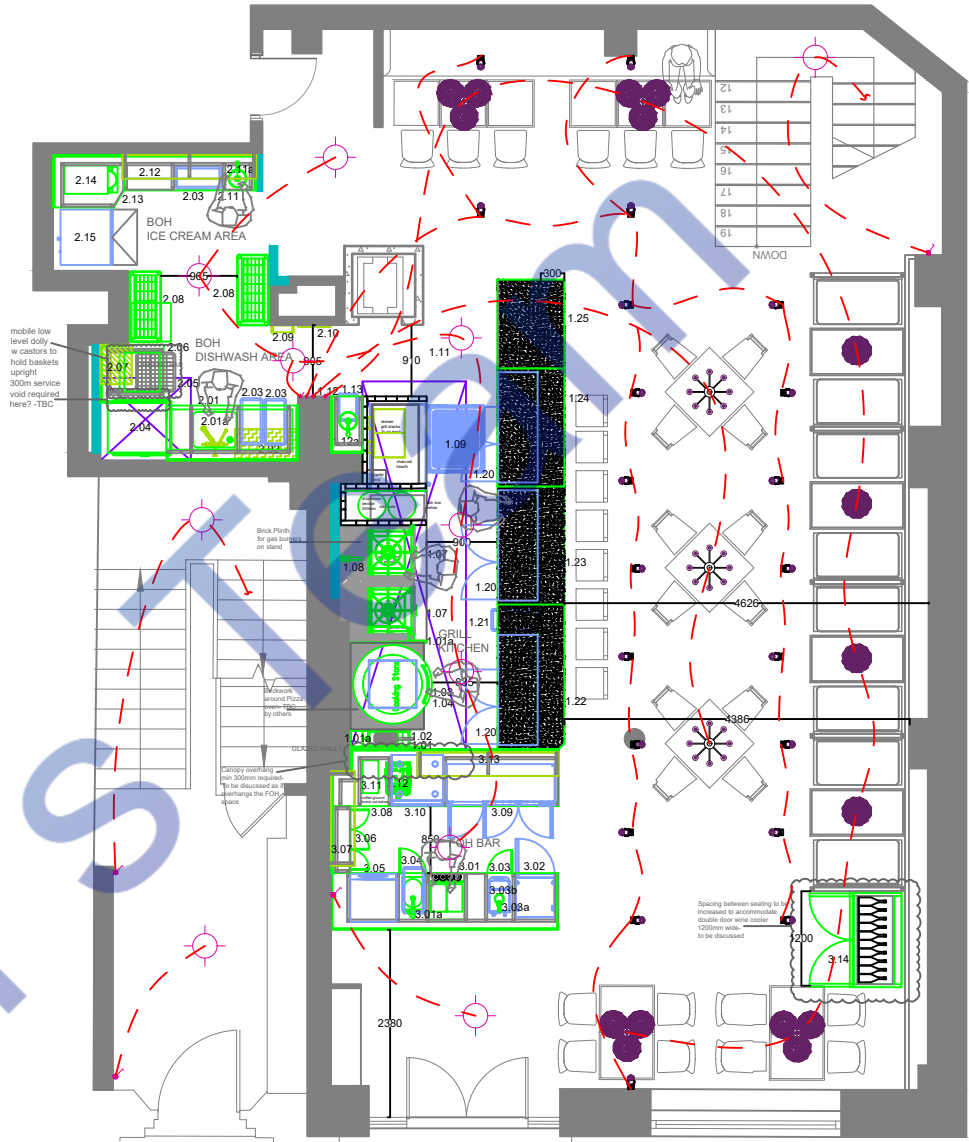

Color Coding Heights:

- Ceiling
- 1600mm
- 1200mm
- 750mm
- 450mm

30W CEILING MOUNT SANDAL LIGHT
10W CEILING MOUNT SANDAL LIGHT
40W CEILING MOUNT SANDAL LIGHT
10W SPOT LIGHT



THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE.

IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:

Rev	Description	Date	By	Key Plan:

Note:


Project: Kitchen & Bar			Drawing No. E-1	
Client: Daka Daka			Drawing Name: Electrical Lighting Plan	
Date: 01/01/2025	Paper Size: A3	Scale on A3: 1:100	Author: MP	Checker: AT



BASEMENT



GF Option 1

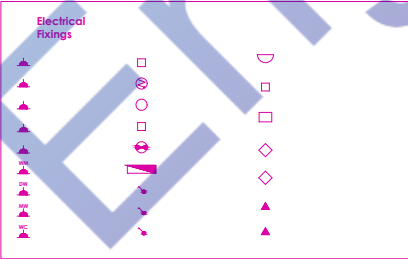

- Color Coding Heights:
- Ceiling
 - 1600mm
 - 1200mm
 - 750mm
 - 450mm

THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE. ©

SITE SPECIFIC HAZARDS

IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:

Rev	Description	Date	By	Key Plan:



Note:

1600

Project:	Kitchen & Bar	Drawing No.	E-2
Client:	Daka Daka	Drawing Name:	Electrical Power Plan
Date:	01/01/2025	Paper Size:	A3
Scale on A3:	1:100	Author:	MP
Checker:	AT		



GF Option 1

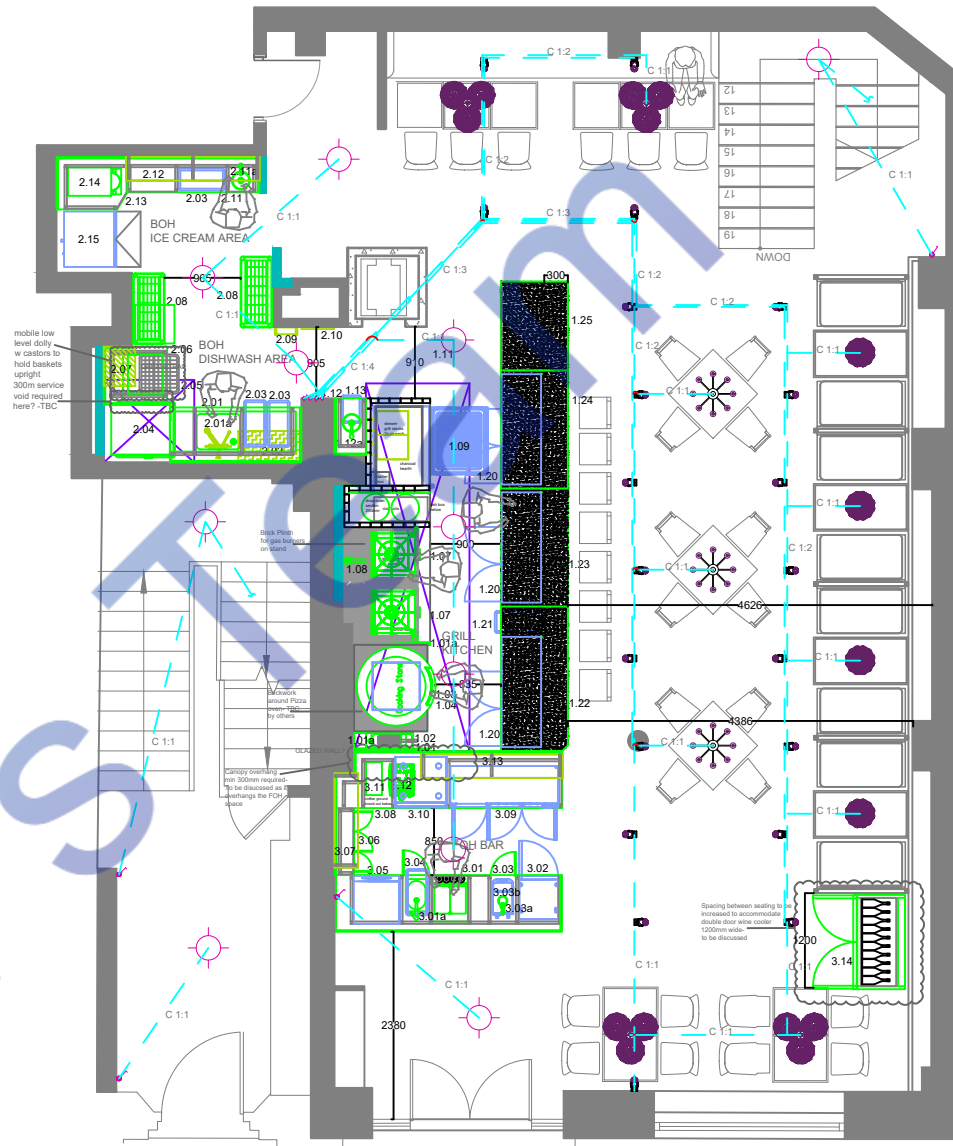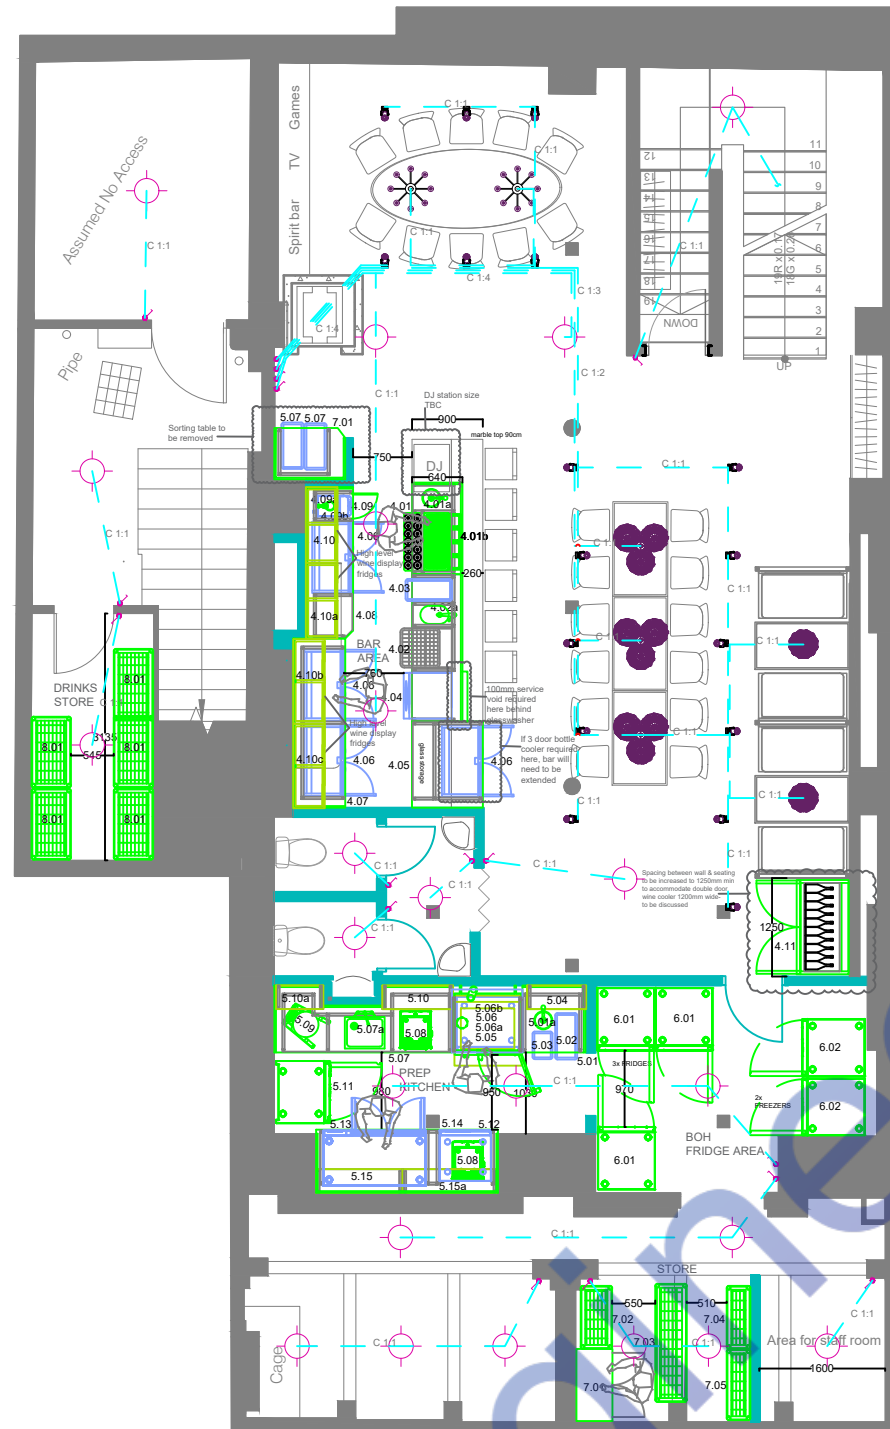

Color Coding Heights:


-  Ceiling
-  1 600mm
-  1 200mm
-  750mm
-  450mm

THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE. © SITE SPECIFIC HAZARDS IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:	Rev	Description	Date	By	Key Plan:	Note:	Project:		Drawing No.			
							Kitchen & Bar		E-3			
							Client:		Drawing Name:			
							Daka Daka		Electrical Conduit Plan			
							Date:	Paper Size:	Scale on A3:	Author:		Checker:
							01/01/2025	A3	1:100	MP		AT

www.atcostudio.co.uk
info@atcostudio.co.uk


BASEMENT DISTRIBUTION BOARD																			
Panel Location-																			
Voltage (Phase-Ground/Phase-Phase) 230				415	Source of Supply-From Service Disconnect/Meter														
Phase 3					Wire-5														
Rated Amps-36					AIC- 10k														
MCCB 3-Phase 100				Amps MCCB	Mounting- Wall Surface														
Circuit	Description	New/ Existing	Load Type	Breaker Size	Poles	Wire Size	A		B		C		Wire Size	Poles	Breaker Size	Load Type	New/ Existing	Description	Circuit
1	LIGHTING LOAD	N		15	1	#14	790	6300											2
3	Blast Chiller (5.05)	N		20	1	#12			930	6300			#10	3	30		N	Combi Oven (5.06)	4
5	Prover Cabinet (5.11)	N		20	1	#12					670	6300							6
7	Planetary Mixer (5.09)	N		20	1	#12	450	740					#12	1	20		N	2xVacuum Packager (5.08)	8
9	3xGN Fridges (6.01)	N		20	1	#12			600	1300			#12	1	20		N	2xGN Freezers (6.02)	10
11	CT-1	N		20	1	#12					500	300	#12	1	20		N	CT-2	12
13	CT-3	N		20	1	#12	300	600					#12	1	20		N	CT-4	14
15	SPARE	--	--	--	--	--			0	0			--	--	--		--	SPARE	16
17	SPARE	--	--	--	--	--					0	0	--	--	--		--	SPARE	18
19	SPARE	--	--	--	--	--	0	0					--	--	--		--	SPARE	20
Connected Load (W)							A		B		C		Total						
Divided by 3-phase multiplayer (1.732) and line to line voltage 415 V							9180		9130		7770		26080						
Connected Amps							36												
Main Type and Amps Rating							3-Phase 100 Amps MCCB												
Demand Load Calculation																			
Load Classification		Connected Load	Demand Factor	Estimated Demand															
Lighting - Dwelling Unit		790	125%	987.5															
Water Heater - Dwelling Unit		930	100%	930															
Receptacle		6050	65%	3932.5															
Cooling		930	100%	930															
Pump		0	125%	0															
Other		0	100%	0															
Demand Load		8700		6780															
Demand Amps				19															

GROUND FLOOR DISTRIBUTION BOARD																				
Panel Location-																				
Voltage (Phase-Ground/Phase-Phase) 230			415	Source of Supply-From Service Disconnect/Meter																
Phase 3				Wire-5																
Rated Amps- 72				AIC- 10k																
MCCB 3-Phase 100			Amps MCCB	Mounting- Wall Surface																
Circuit	Description	New/ Existing	Load Type	Breaker Size	Poles	Wire Size	A	B	C	Wire Size	Poles	Breaker Size	Load Type	New/ Existing	Description	Circuit				
1	LIGHTING LOAD	N		15	1	#14	670	3935								2				
3	WATER HEATER	N		20	1	#12			2000	3935				N	Electric Turbo Fryer (1.02)	4				
5	Refrigerated Counter (1.20)	N		20	1	#12					1440	3935				6				
7	Refrigerated Counter (1.20)	N		20	1	#12	1440	6500						N	Pass Through Dishwasher (2.04)	8				
9	Refrigerated Counter (1.20)	N		20	1	#12			1440	2200				N	Countertop Batch Freezer (2.14)	10				
11	Bottle Cooler (3.02)	N		20	1	#12					1000	870		N	Ice Maker (2.15)	12				
13	Coffee Machine (3.14)	N		25	1	#10	4700	3120						N	Wine Cooler (3.16)	14				
15	Under Counter Dishwasher (3.06)	N		35	1	#08			6500	6500				N	Under Counter Glasswasher (4.04)	16				
17	4xBack Bar Cabinets (4.06)	N		20	1	#12					800	500		N	CT-5	18				
19	SPARE	--		--	--	--	0	0					--	--	SPARE	20				
Connected Load (W)							A	B	C	Total										
Divided by 3-phase multiplayer (1.732) and line to line voltage 415 V							20365	22575	8545	51485										
Connected Amps							72													
Main Type and Amps Rating							3-Phase 100 Amps MCCB													
Demand Load Calculation																				
Load Classification		Connected Load	Demand Factor	Estimated Demand																
Lighting - Dwelling Unit		670	125%	837.5																
Water Heater - Dwelling Unit		2000	100%	2000																
Receptacle		5875	65%	3818.75																
Cooling		0	100%	0																
Pump		0	125%	0																
Other		0	100%	0																
Demand Load		8545		6656.25																
Demand Amps				18																



GROUND LEVEL

BASEMENT LEVEL

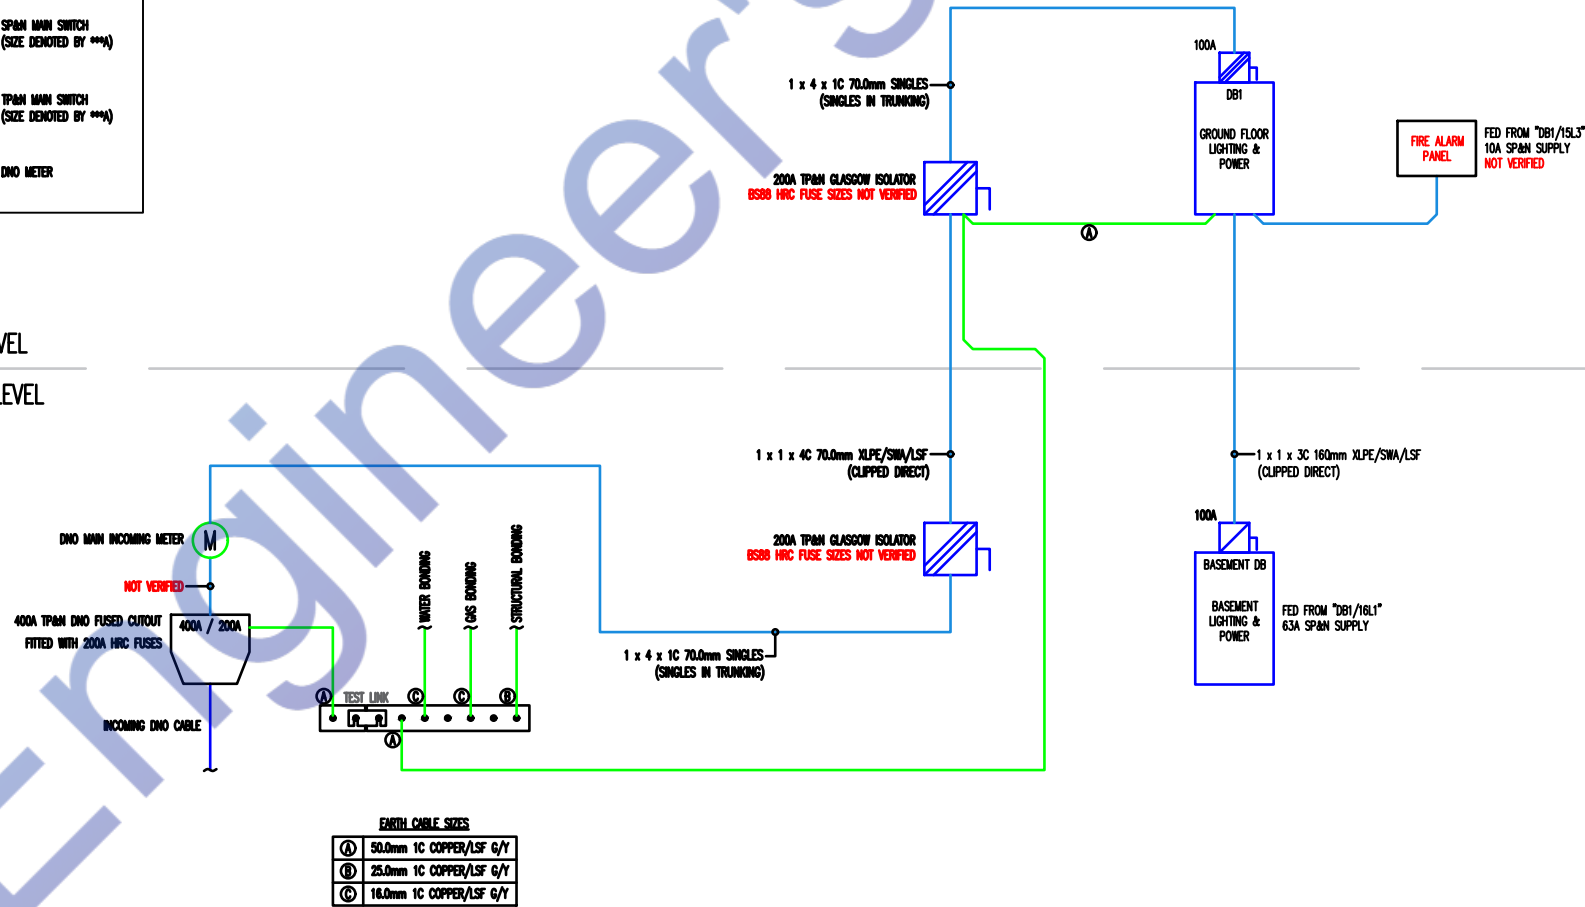

THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE. ©

SITE SPECIFIC HAZARDS

IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:

Rev	Description	Date	By	Key Plan:

Note:



Project:
Kitchen & Bar

Client:
Daka Daka

Date:
01/01/2025

Paper Size:
A3

Scale on A3:
1:100

Author:
MP

Checker:
AT

Drawing No.

E-4

Drawing Name:

Electrical Load Schedule Plan and SLD



ATCO Studio

Design Your Way

www.atcostudio.co.uk

info@atcostudio.co.uk

GENERAL NOTES:

1. A LISTED INTERSYSTEM BONDING TERMINATION PROVIDING THE REQUIRED NUMBER OF TERMINALS (MINIMUM OF THREE) FOR CONNECTING OTHER BUILDING SYSTEMS TO THE GROUNDING SYSTEM OF THE ELECTRICAL POWER SUPPLY (NEC250.44).

KEY NOTES:


1. ALL METAL CONDUITS ENCLOSING ANY SERVICE SHALL BE FITTED WITH A "BONDING BUSHING".
2. ALL METAL CONDUITS ENCLOSING ANY GROUNDING ELECTRODE CONDUCTOR SHALL BE FITTED WITH A "BONDING BUSHING" AT EACH END.
3. PROVIDE GROUNDING ELECTRODE PER NEC. ELECTRODE SHALL BE IN THE FORM OF A 20'-0" x 1/2" COPPER CLAD GROUND ROD LAID AT LEAST 2" OFF THE BOTTOM OF A CONCRETE FOOTING. SECURE THE GROUND ROD TO THE REBAR WITH STEEL TIE WRAPS. IF THE REBAR BEING USED IN THE FOOTING IS SMALLER THAN 1/2" (#4), THEN USE 20' OF BARE

- SOLID #4 COPPER WIRE IN PLACE OF THE GROUND ROD. IN REMODEL PROJECTS THAT WILL NOT HAVE NEW FOOTINGS INSTALLED, THIS SUPPLEMENTAL ELECTRODE SHALL BE PER NOTE #4 BELOW OR OTHER ELECTRODE PER NEC 250.52.
4. FOR CONNECTION TO COLD WATER MAIN. CONNECT WITHIN 5 FT. OF CONTACT OF EARTH.
5. IF STRUCTURAL STEEL MEMBER OR REBARS ARE AVAILABLE, BOND IT TO THE SERVICE USING A UL LISTED IRREVERSIBLE CLAMP OR WELDING LUG.
6. PROVIDE A INTERSYSTEM BONDING TERMINATION PER NEC 250.44.


- INTERSYSTEM BONDING TERMINATION SHALL:
- 6.1. BE ACCESSIBLE FOR CONNECTION AND INSPECTION.
- 6.2. CONSIST OF A SET OF TERMINALS (LISTED AS GROUNDING AND BONDING EQUIPMENT) WITH THE CAPACITY OF NOT LESS THAN THREE INTERSYSTEM BONDING CONDUCTORS.
- 6.3. BE SECURELY MOUNTED AND ELECTRICALLY CONNECTED TO SERVICE EQUIPMENT, METER ENCLOSURE, OR EXPOSED NON METALLIC SERVICE RACEWAY, OR BE MOUNTED ON ONE OF THESE ENCLOSURES AND BE CONNECTED TO THE ENCLOSURE OR GROUNDING

- ELECTRODE CONDUCTOR WITH A MINIMUM #6 CU CONDUCTOR.
- 6.4. BE SECURELY MOUNTED TO THE BUILDING'S DISCONNECTING MEANS, OR BE MOUNTED AT THE DISCONNECTING MEANS AND BE CONNECTED TO THE METALLIC ENCLOSURE OR GROUNDING ELECTRODE CONDUCTOR WITH A MINIMUM #6 CU CONDUCTOR.
7. ALL BRANCH CIRCUIT AND FEEDER CONDUITS ARE TO HAVE AN INSULATED EQUIPMENT GROUNDING CONDUCTOR REGARDLESS OF THE CONDUIT MATERIAL.
8. WHEN THE SERVICE CONSISTS OF MULTIPLE DISCONNECTING MEANS IN SEPARATE ENCLOSURES, CONNECT A TAP

- CONDUCTOR FROM THE MAIN GROUNDING ELECTRODE CONDUCTOR TO EACH DISCONNECTING MEANS. SIZE THIS TAP BASED ON THE LARGEST SERVICE CONDUCTOR IN THAT SERVICE DISCONNECT ENCLOSURE.
9. #6 COPPER GROUNDING ELECTRODE CONDUCTOR.
10. INSTALL #6 CU TO TWO 5/8" x 8' MIN. GROUND RODS AS SHOWN.
11. #4 COPPER GROUNDING ELECTRODE CONDUCTOR.
12. COPPER GROUNDING ELECTRODE CONDUCTOR. PROVIDE #6 COPPER

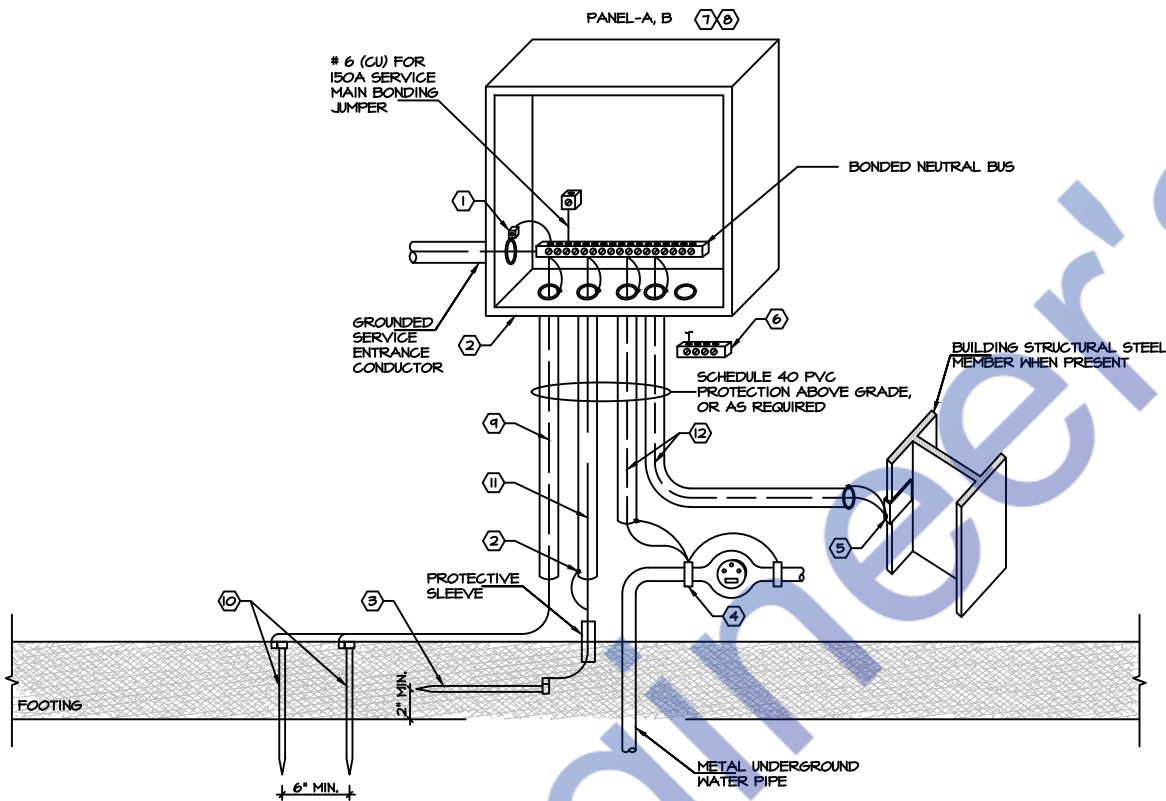

1 GROUNDING ELECTRODE SYSTEM DIAGRAM
SCALE: NOT TO SCALE

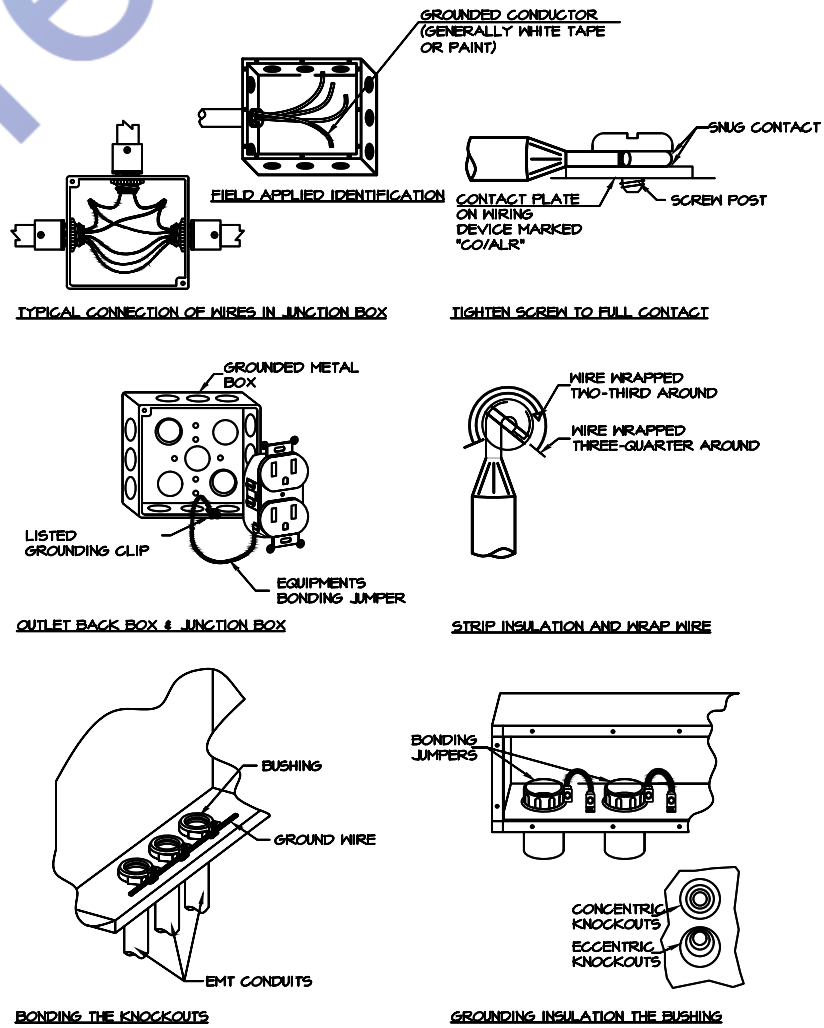

2 BONDING DETAILS
SCALE: NOT TO SCALE

THIS DRAWING IS PROTECTED BY COPYRIGHT AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT ATCO GROUP LTD. NO DIMENSIONS ARE TO BE SCALED FROM THIS DRAWING. ALL DIMENSIONS AND SIZES TO BE CHECKED ON SITE. NORTH POINTS SHOWN ARE INDICATIVE.

SITE SPECIFIC HAZARDS

IN ACCORDANCE WITH THE REQUIREMENTS OF THE CDM REGULATIONS 2007 THE FOLLOWING SIGNIFICANT RESIDUAL HAZARDS HAVE NOT BEEN DESIGNED OUT OF THIS PROJECT AND MUST BE TAKEN INTO CONSIDERATION BY CONTRACTORS PLANNING TO UNDERTAKE THE WORKS SHOWN ON THIS DRAWING:

Rev	Description	Date	By	Key Plan:

Note:



Project: Kitchen & Bar		Drawing No. E-5		
Client: Daka Daka		Drawing Name: Electrical Installation		
Date: 01/01/2025	Paper Size: A3	Scale on A3: 1:100	Author: MP	Checker: AT



Watermarkly

ATCO Studio
Design Your Way
www.atcostudio.co.uk
info@atcostudio.co.uk



Designed By Engr. Al Amin (MEP Engineer | Director - Engineer's Team LTD)

 support@engrteam.com

 <https://engrteam.com>

OUR SERVICES:

- MEP Plan Services
- HVAC Layout Plan
- Electrical Engineering Services
- Plumbing Engineering Services
- Fire protection & Security systems
- Specialized services

INFORMATION:

- Studio
- Contact Us
- Gift cards
- Privacy Policy
- Refund Policy
- Delivery Policy